

# Target system for hadron & neutrino beam lines at J-PARC

Y.Yamada (KEK-IPNS)

for Nuclear/Particle physics group at J-PARC

(Hadron beam-line SG, Neutrino beam-line SG, Target/Monitor SG)

High-power Targetry for Future Accelerators

September 8, 2003



## Contents

- Introduction of J-PARC
- Target and Target system for hadron beam line
- Target system for neutrino beam line  
(Y.Hayato will talk about neutrino target tomorrow)

# J-PARC

## J-PARC:

## Japan Proton Accelerator Research Complex

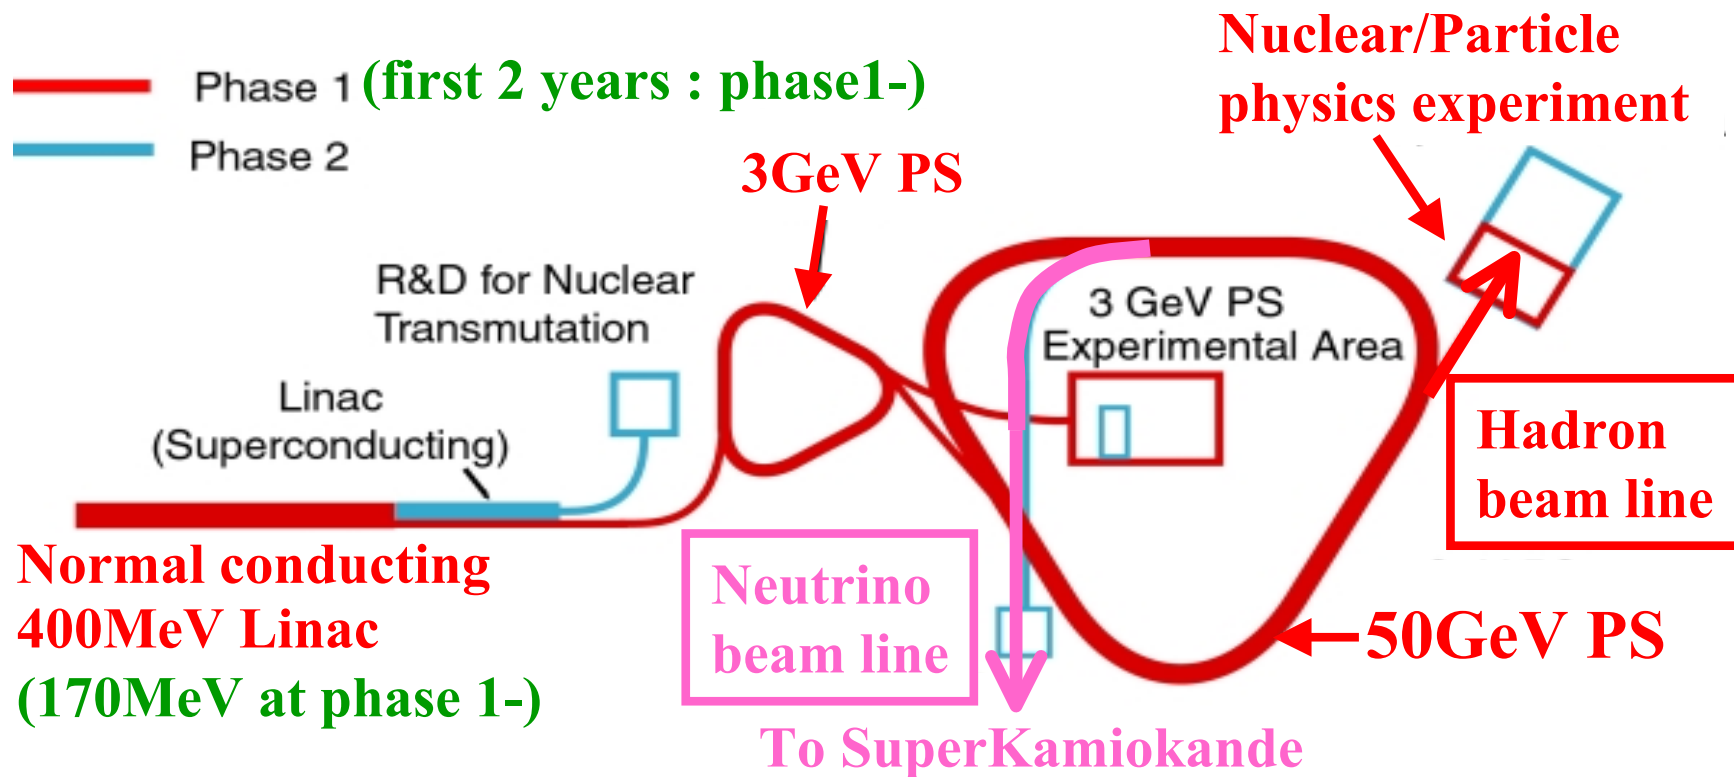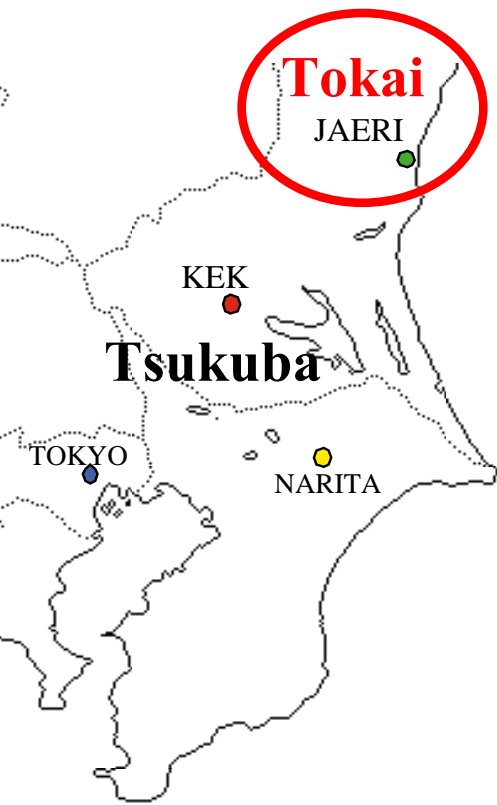


**Phase 1: Approved in 2001, will be completed by 2007**

**Neutrino will be approved for FY2004-8(?)**


# Site View of the Project

Facility for Neutrino Experiment (2004?~2008?)

Facility for Nuclear/Particle Physics experiment (~2007)

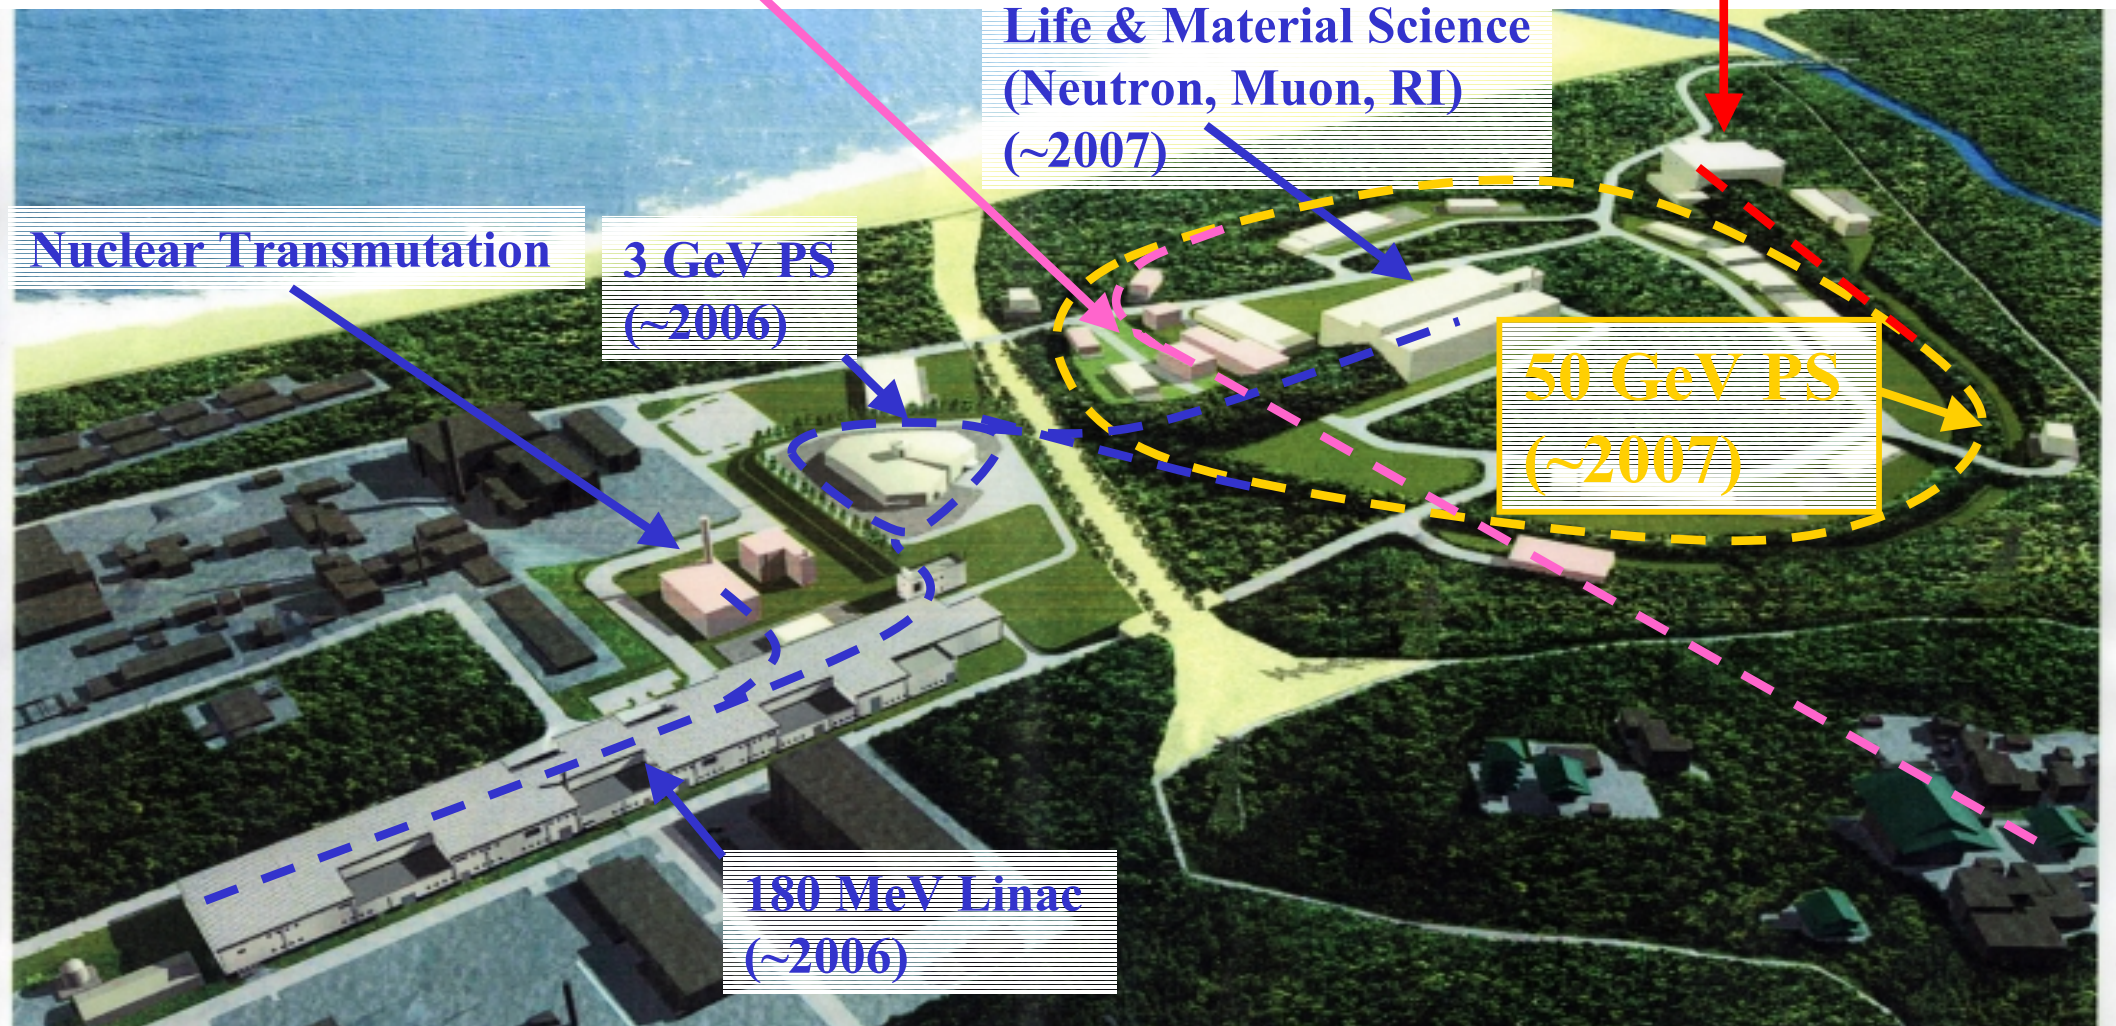

# Machine power

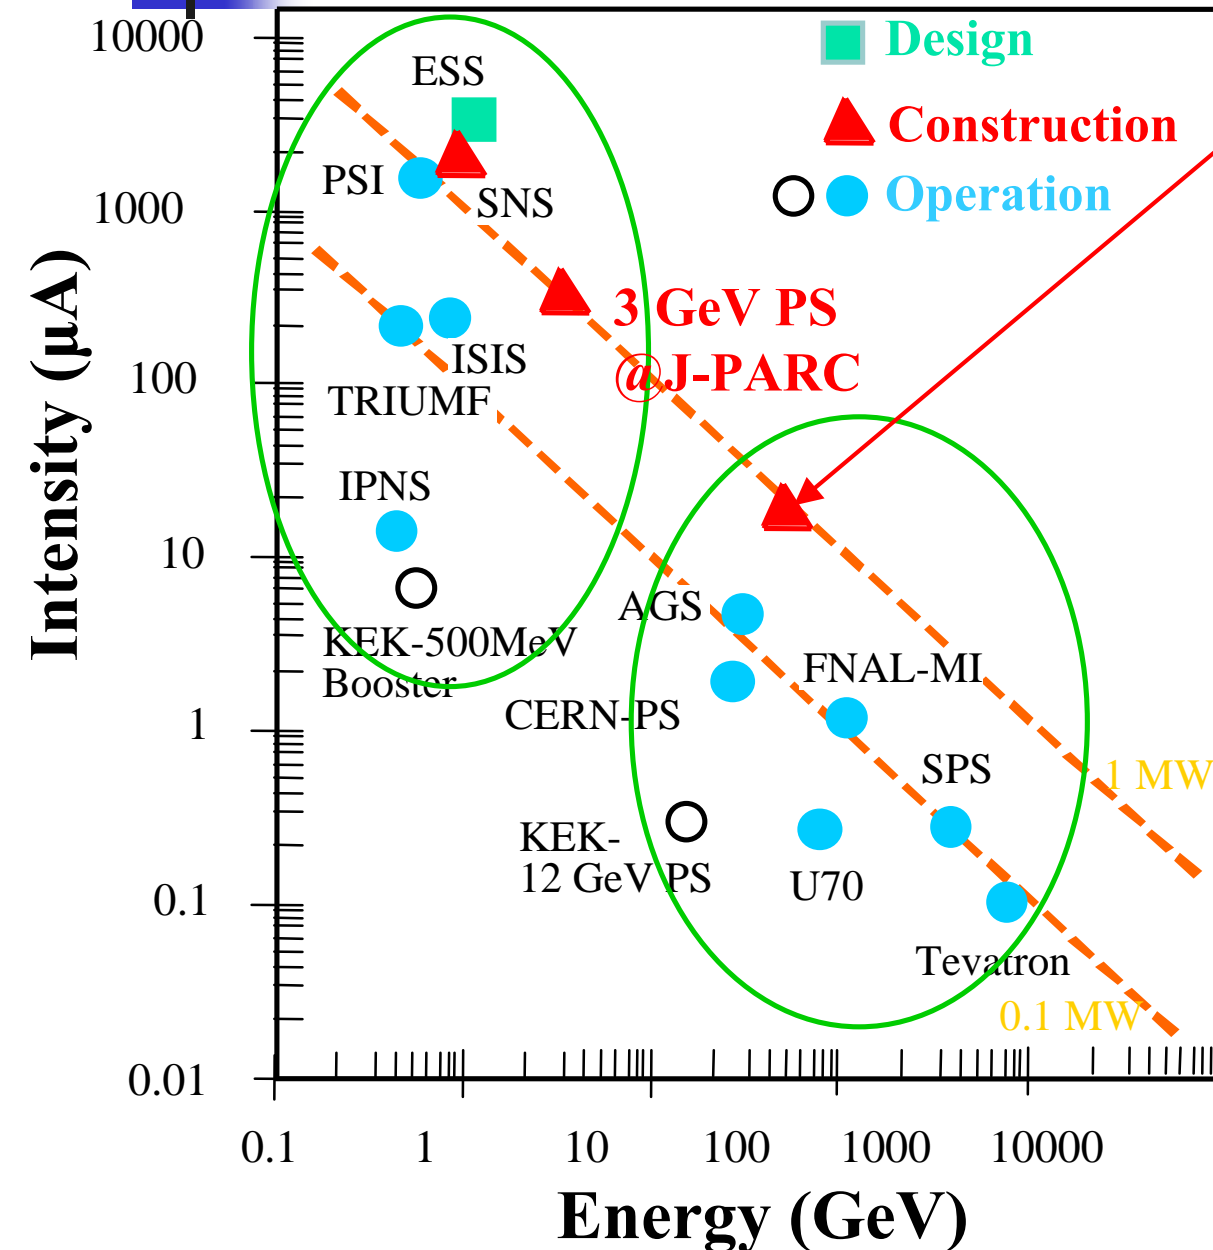

**50 GeV PS @J-PARC**

■ **Beam Energy:**

**50 GeV**

**(40 GeV in Phase1-)**

■ **Beam Intensity:**

**$3.3 \times 10^{14}$  ppp, 15 μA**

**( $2 \times 10^{14}$  ppp, 9 μA in Phase1-)**

**( $18 \times 10^{14}$  ppp, 80 μA in future)**


■ **Beam Power:**

**0.75 MW**

**(0.36 MW at Phase1-)**


**(4 MW in future)**

# Acceleration/extraction cycle

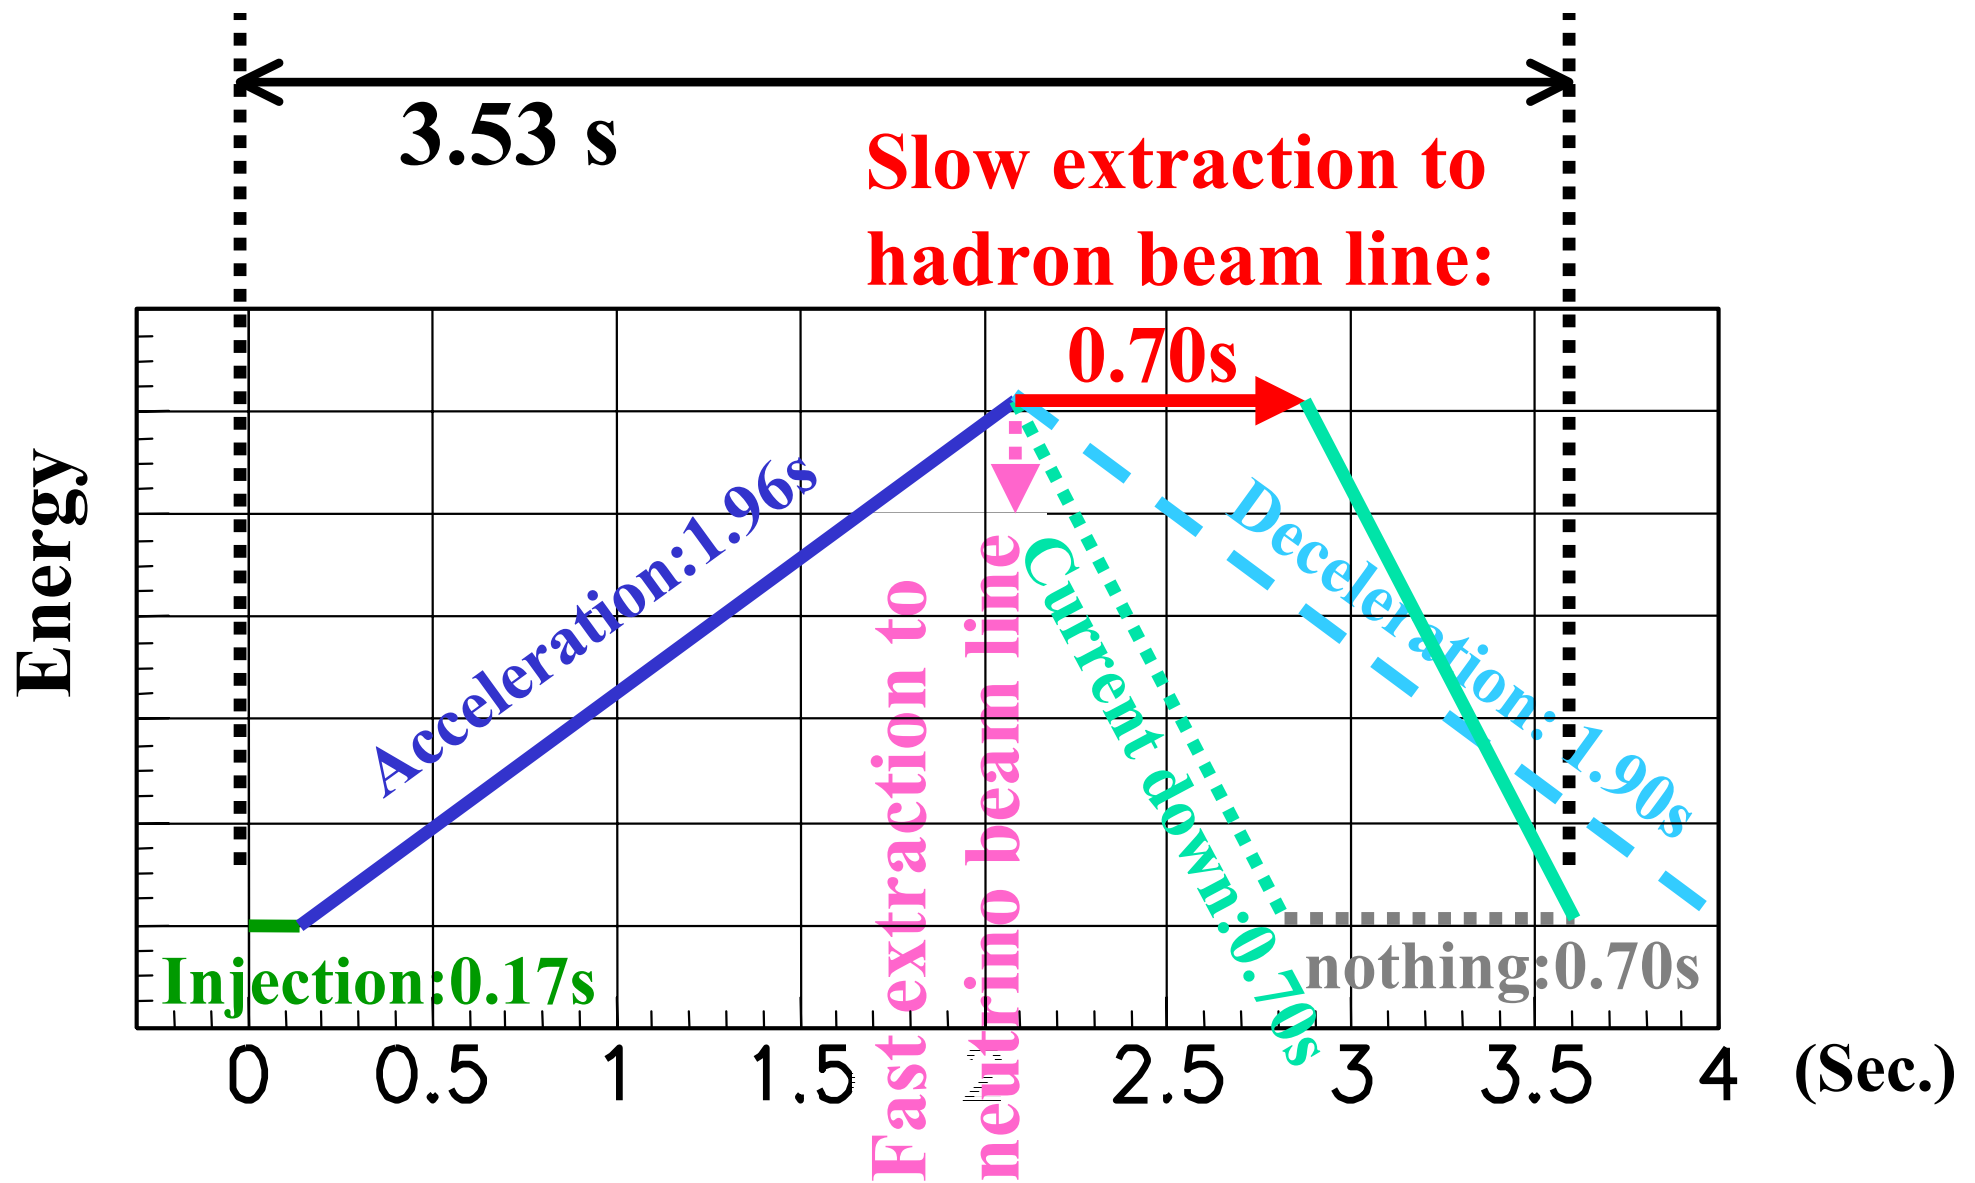

# Hadron beam line

- **Slow extraction beam line**
- **Physics with high intensity secondary K beam**
  - **Strangeness Nuclear physics**
  - **Rare K decay**

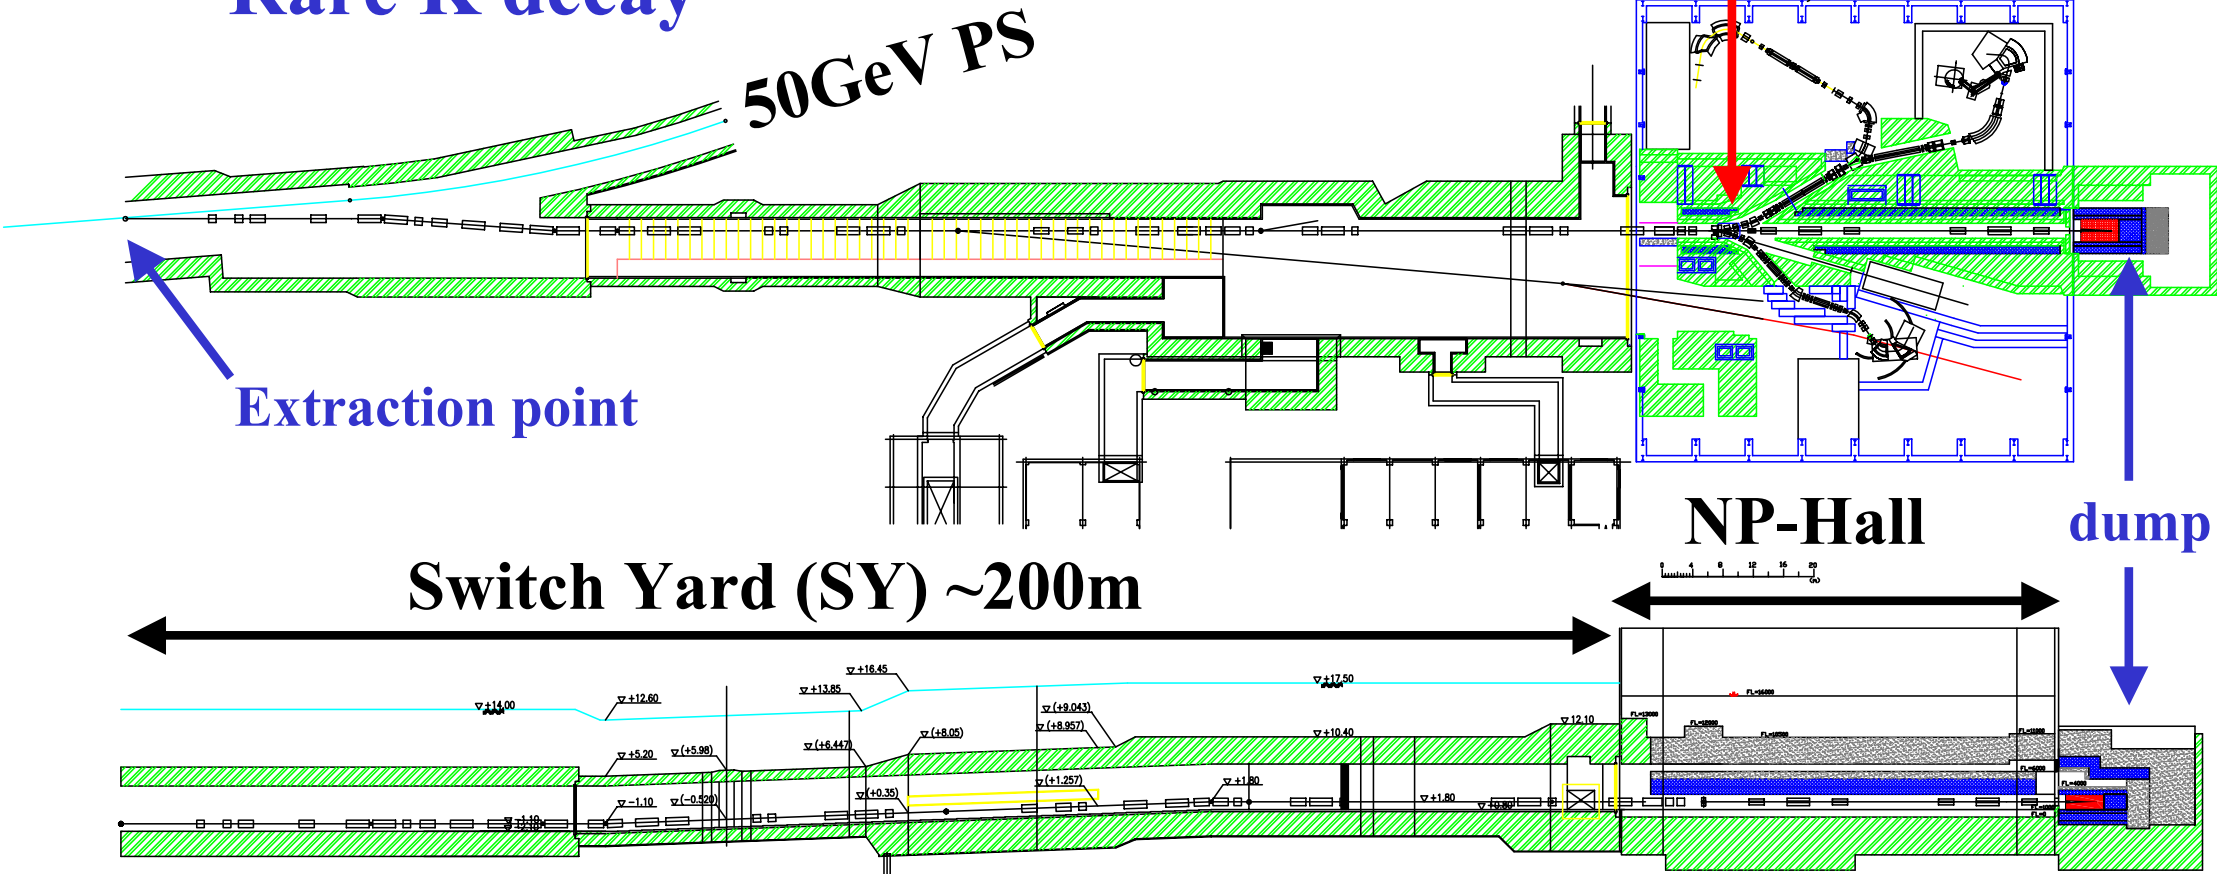

# Target and secondary beam lines



**Production target : T1**

**Rotating Nickel disks**

- thickness: ~54 mm
- radius: ~24 cm
- cooled by water
- developed by **Y.Yamanoi**

et. al.

Proton  
beam

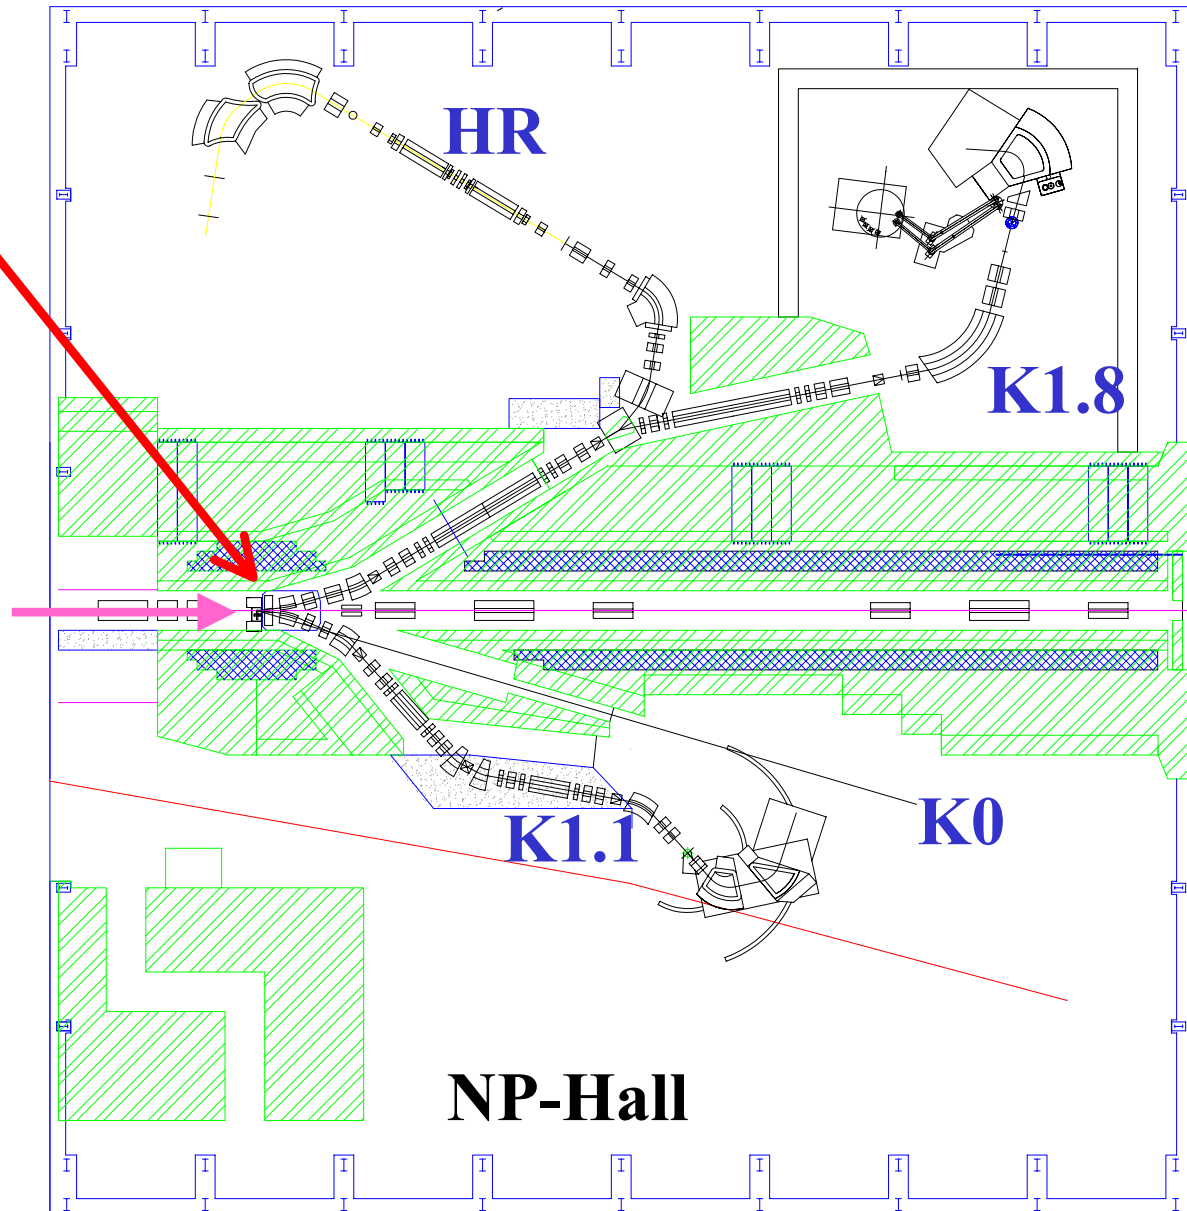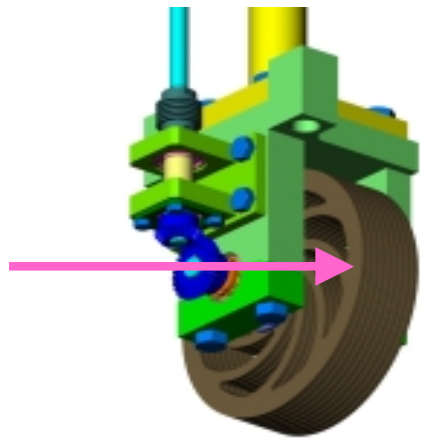



# Design of T1

$1.3 \times 10^{21}$  protons/year on Target (4000 hours/year)

- Radiation shielding
  - Max. yield of secondary beam
- }  $\Rightarrow$  30% interaction
- Temperature rise
  - Point source for secondary beam
- }  $\Rightarrow$  Ni target

	length of 30% interaction (cm)	max. heat density (J/cm <sup>3</sup> )	density (g/cm <sup>3</sup> )	specific heat (J/g/K)	temperature rise by a pulse (K)
Pt	3.15	25000	21.5	0.14	8590
Ni	5.31	5280	8.9	0.44	1340
Al	14.06	1940	2.7	0.87	820




# Water cooling of T1

- **Rotating Ni disks**

- Diameter : 48cm, Thickness : 54 mm (9mm-t×6disks)
- 1 rotation per 0.7s (slow extraction period) : 85 RPM


- **Partially cooled by water**

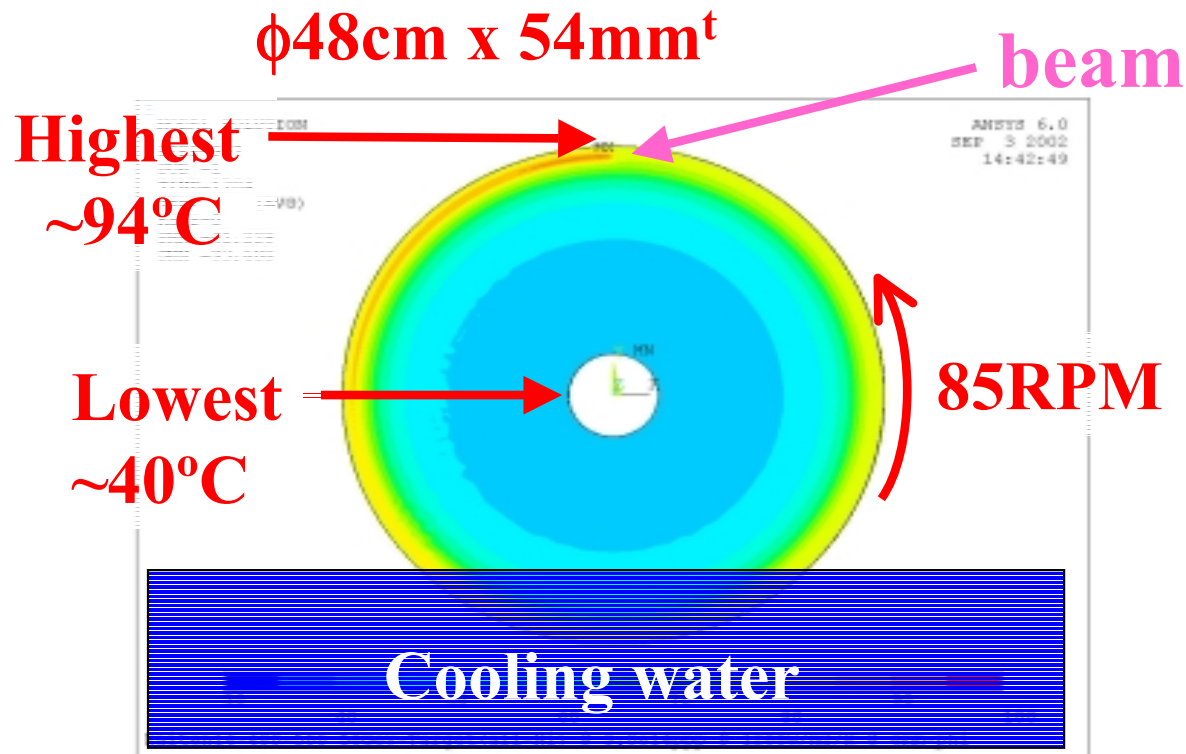

## ANSYS:

- After 0.7s exposure
- $1200 \text{ W/m}^2\text{K}$  assumed

$\phi 24\text{cm} \times 54\text{mm}^t$


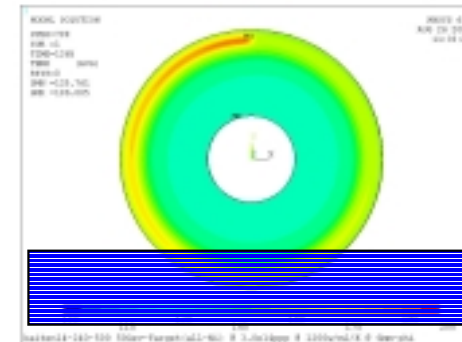


Highest  $\sim 196^\circ\text{C}$   
Lowest  $\sim 136^\circ\text{C}$

# Gas cooling of T1

$\phi 48\text{cm} \times 54\text{mm}^t$

$\phi 48\text{cm} \times 54\text{mm}^t$

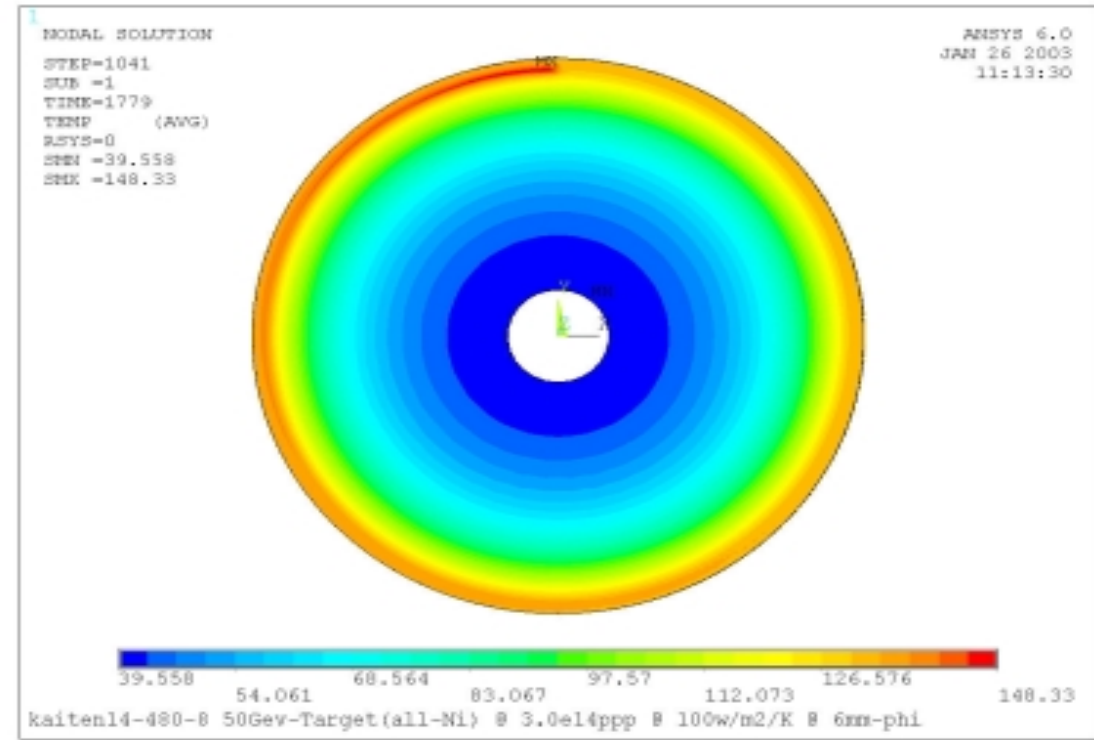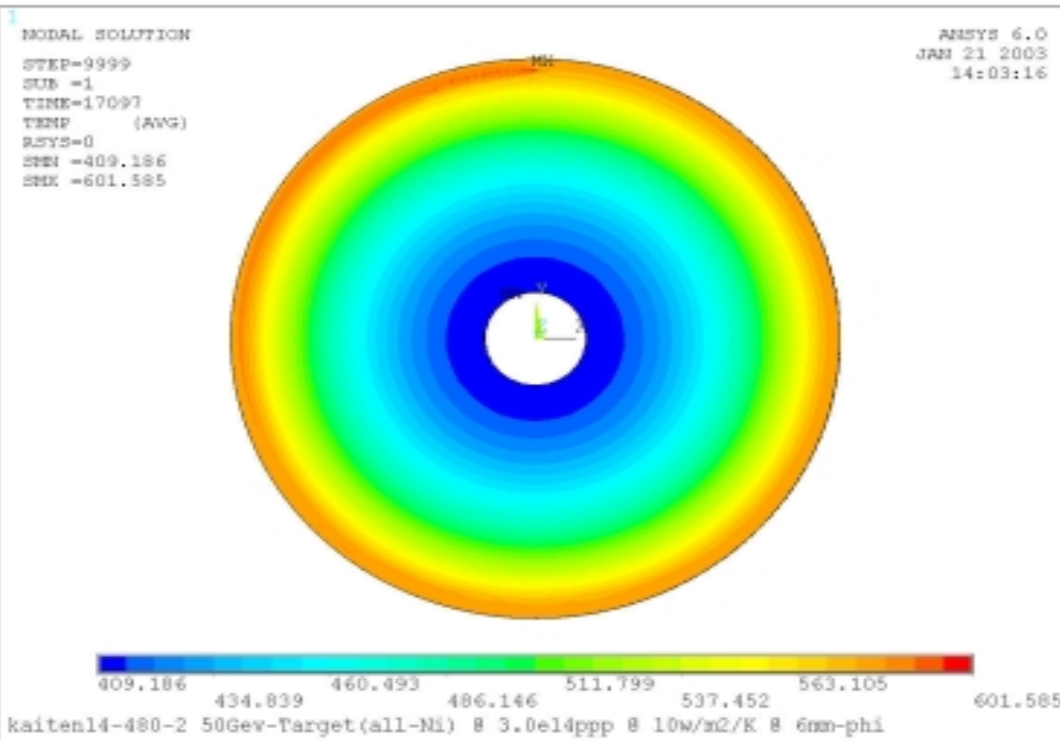

**Natural convection**

**10 W/m<sup>2</sup>K assumed**

**⇒ Highest ~ 602°C: too high**

**Lowest ~ 409°C**

**Forced convection**

**100 W/m<sup>2</sup>K assumed**

**⇒ Highest ~ 148°C: still high**

**Lowest ~ 40°C**

# R&D for T1

## Items


- Optimization of diameter, thickness, # of disks(gaps)
- Rotation speed, Method of rotation
- Durability
- Container & shielding
- Cooling system
- Beam window & vacuum sealing
- Maintenance method



- Prototypes
- Mockup



Nickel disks ( $\phi 24\text{cm} \times 6\text{mm}^t \times 9$ , 24kg)



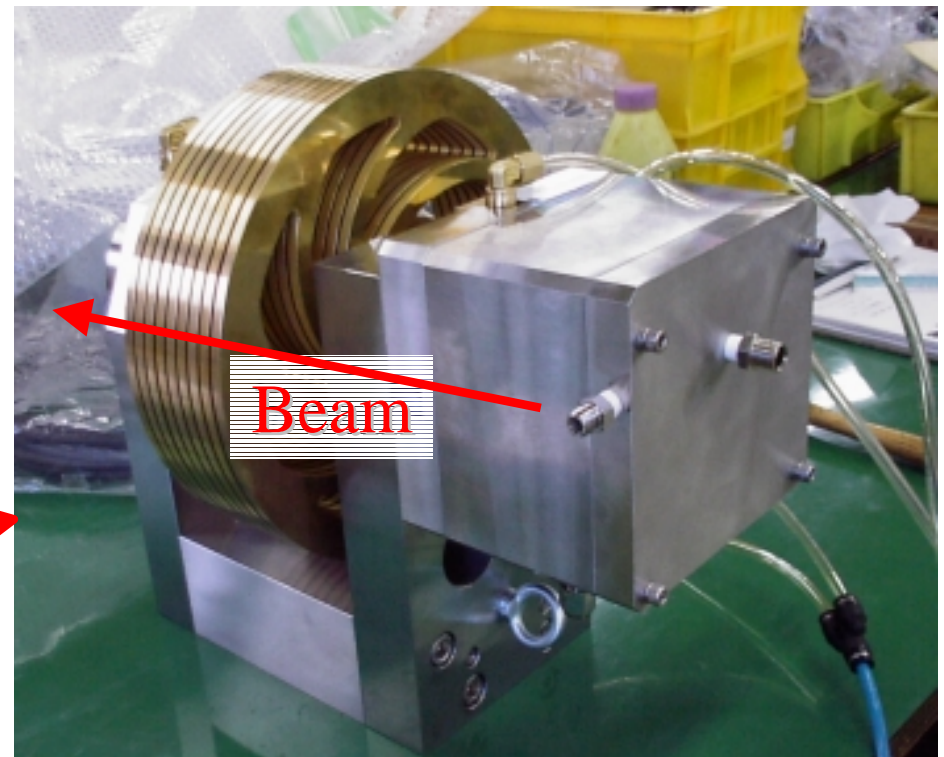


# Water velocity at T1(1)

Relative velocity between disk and water

- affects on heat transfer coefficient
- measured by PIV (Particle Image Velocimetry)

One Ni and two acrylic disks

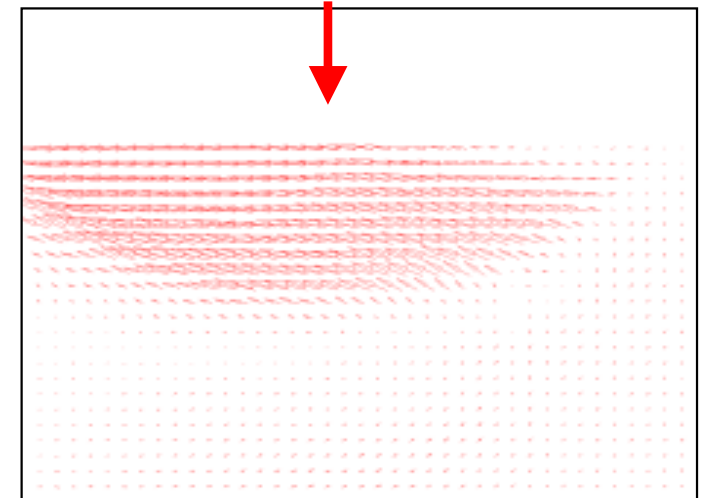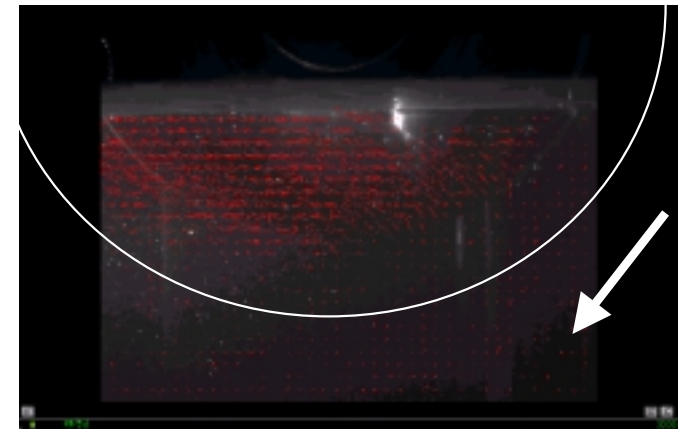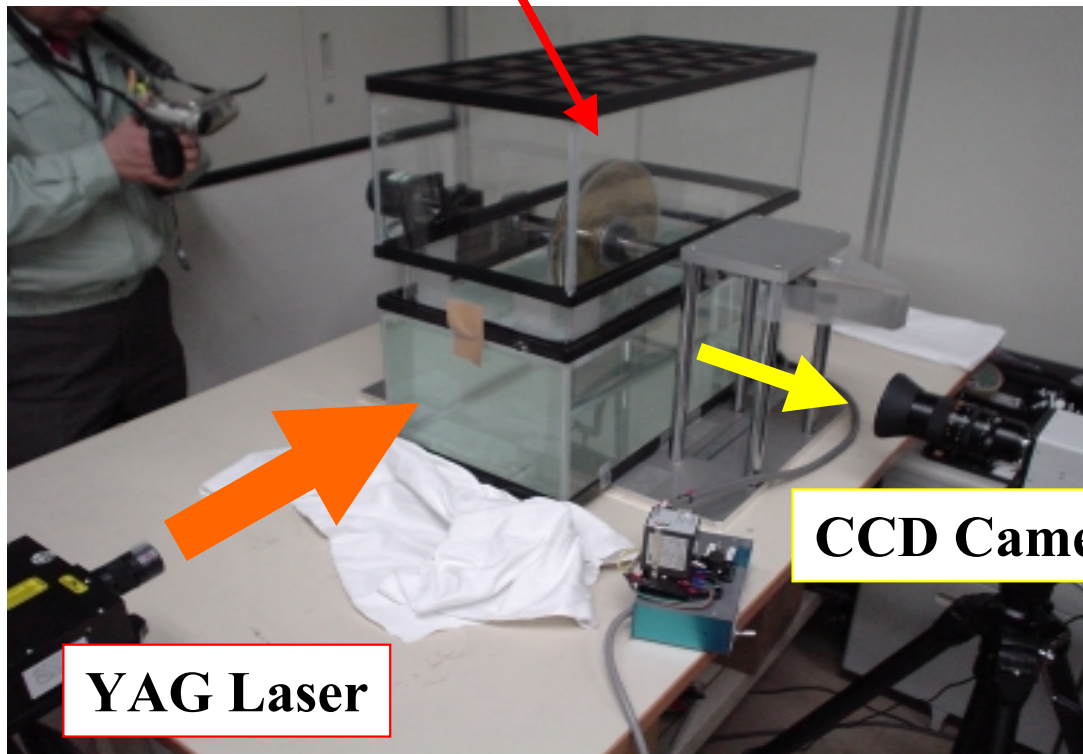


# Water velocity at T1(2)

## •Results:

- Typ. velocity  $\sim 1$  m/s @85RPM
- Gap between disks should be  $> 2$ mm
- RPM should be  $< 150$ RPM


## ⇒Fluid simulation

- Reproduce relative velocity
- Estimate heat transfer coefficient
- Parameter survey on
  - Number of disks (gaps)
  - Gap length
  - Rotation speed
  - Depth in water
  - etc


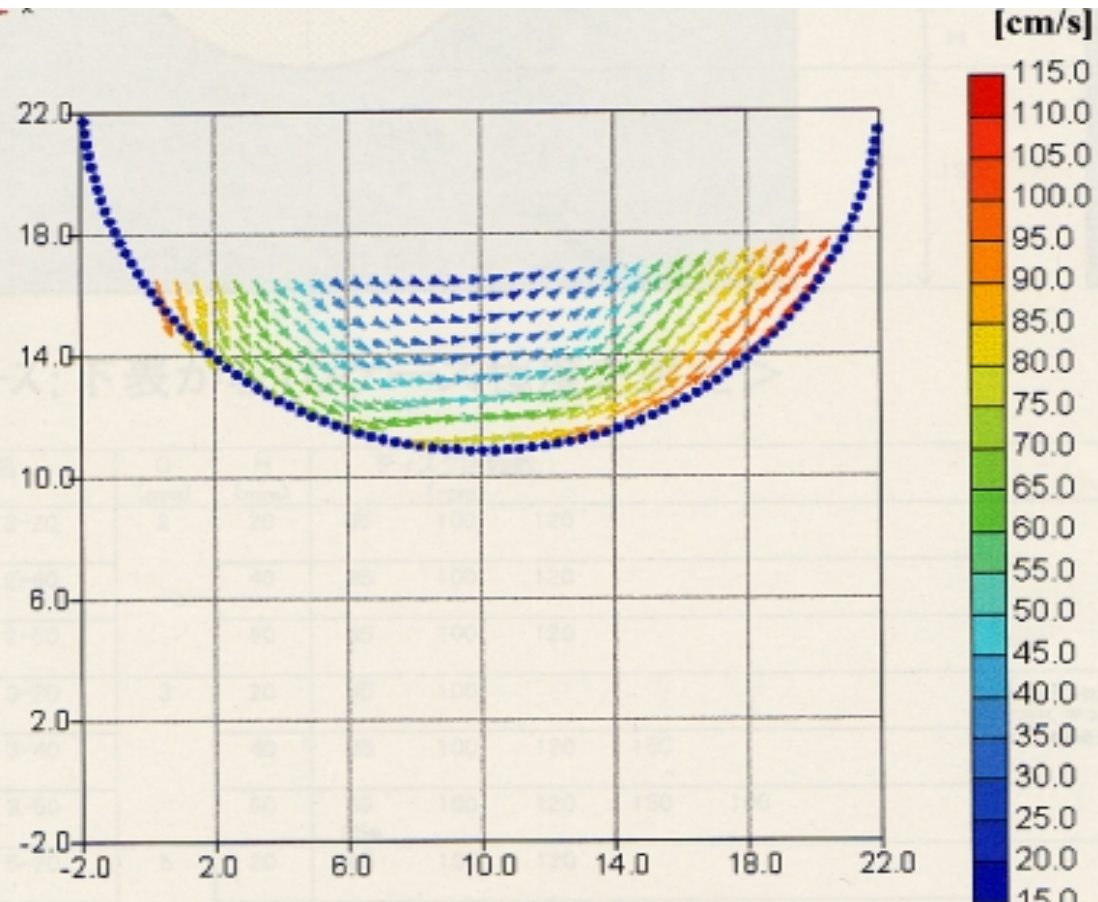


**Measured relative velocity  
between disk and water (cm/s)**

# Container of T1

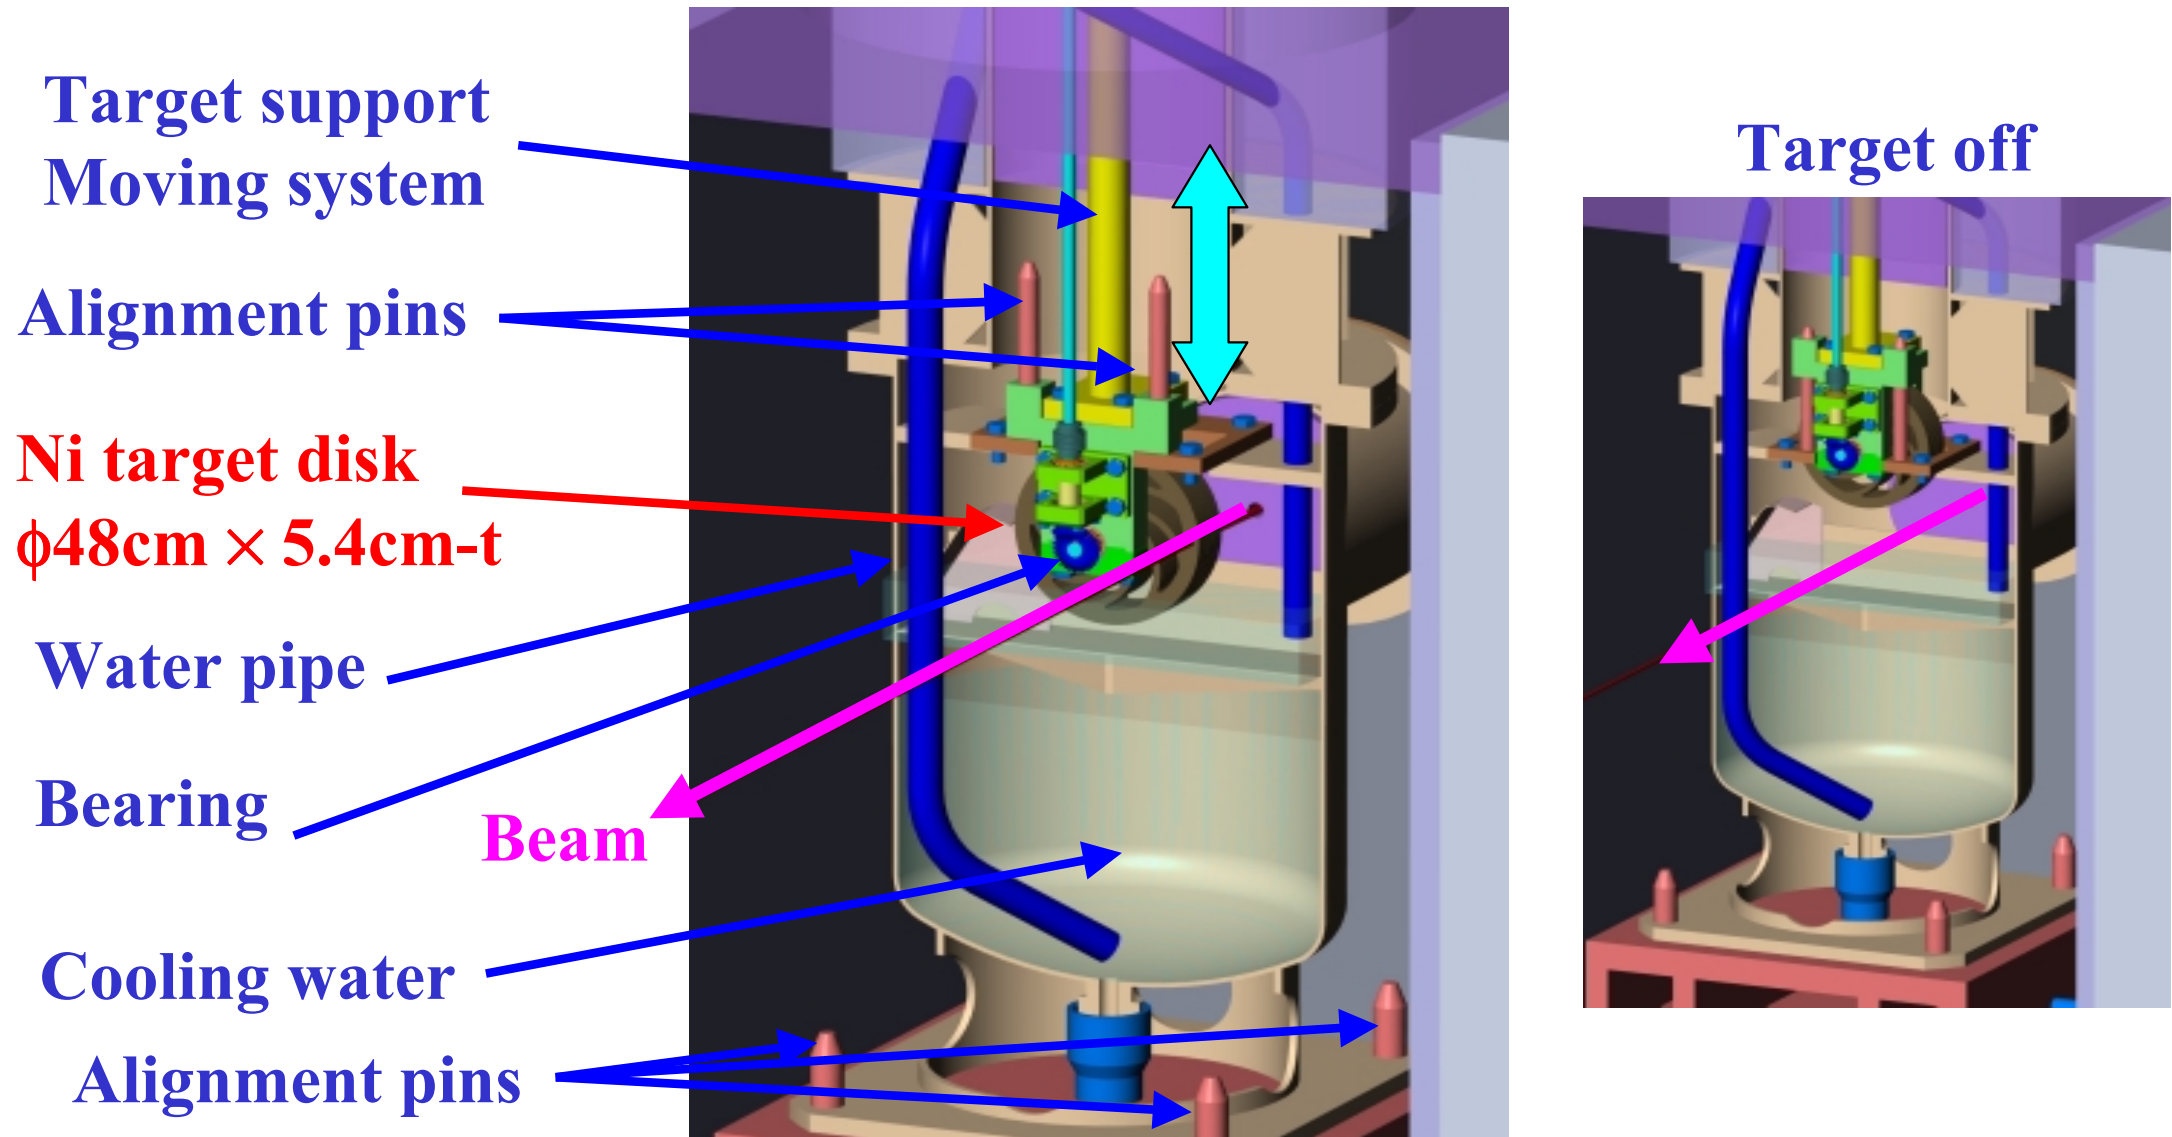

# Cooling system of T1

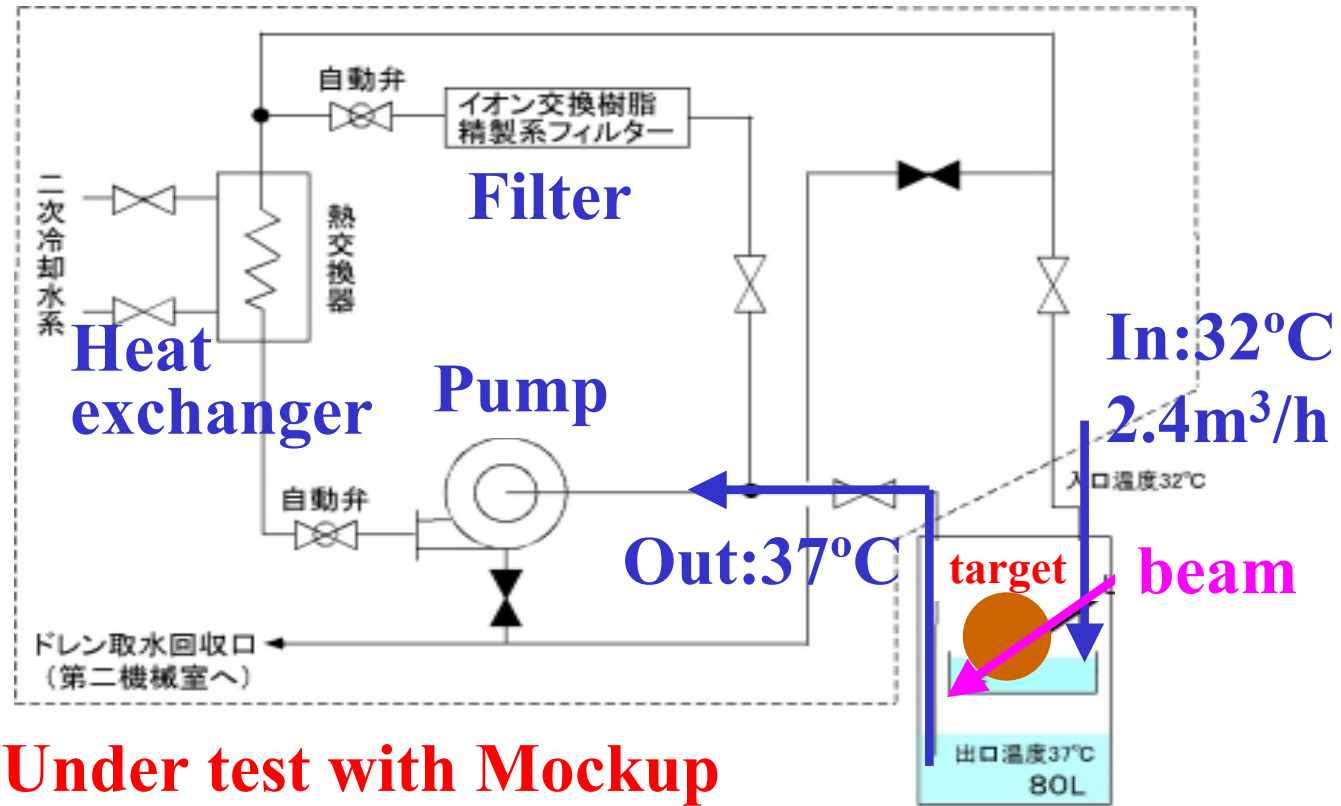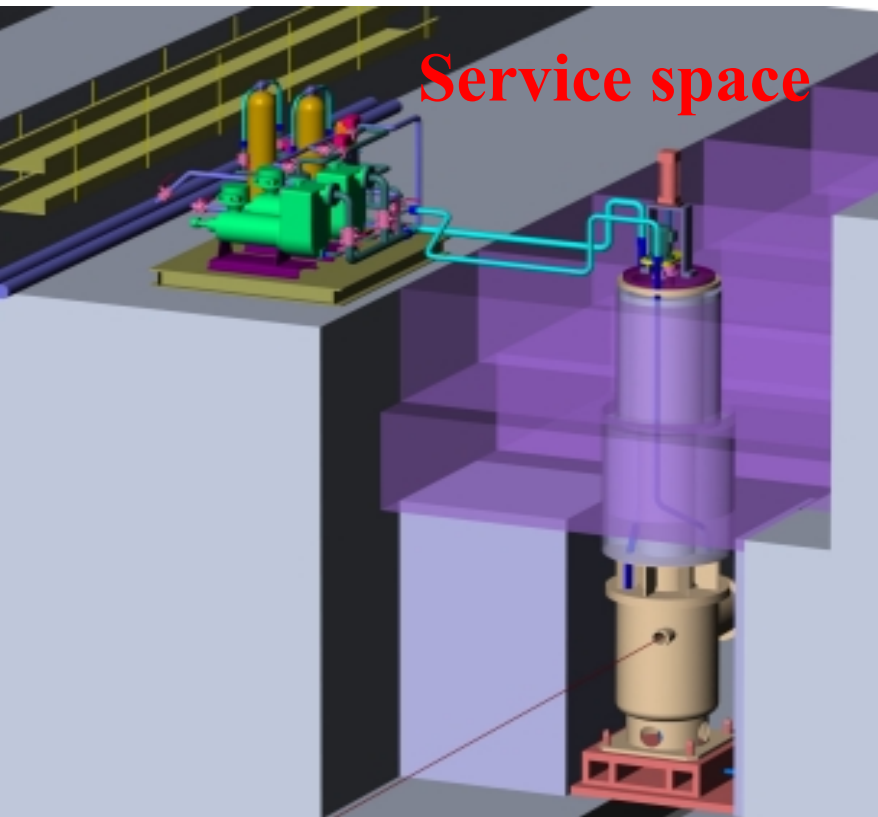



**Under test with Mockup**

**Water tank: 0.08m<sup>3</sup>**

**Radioactivity of water after 30 days operation: ~24 kBq/cm<sup>3</sup>**

- Thinned into 15 Bq/cm<sup>3</sup> and thrown away
- (Thinned into 1.2 kBq/cm<sup>3</sup> and moved by tank track)

# Mockup around T1

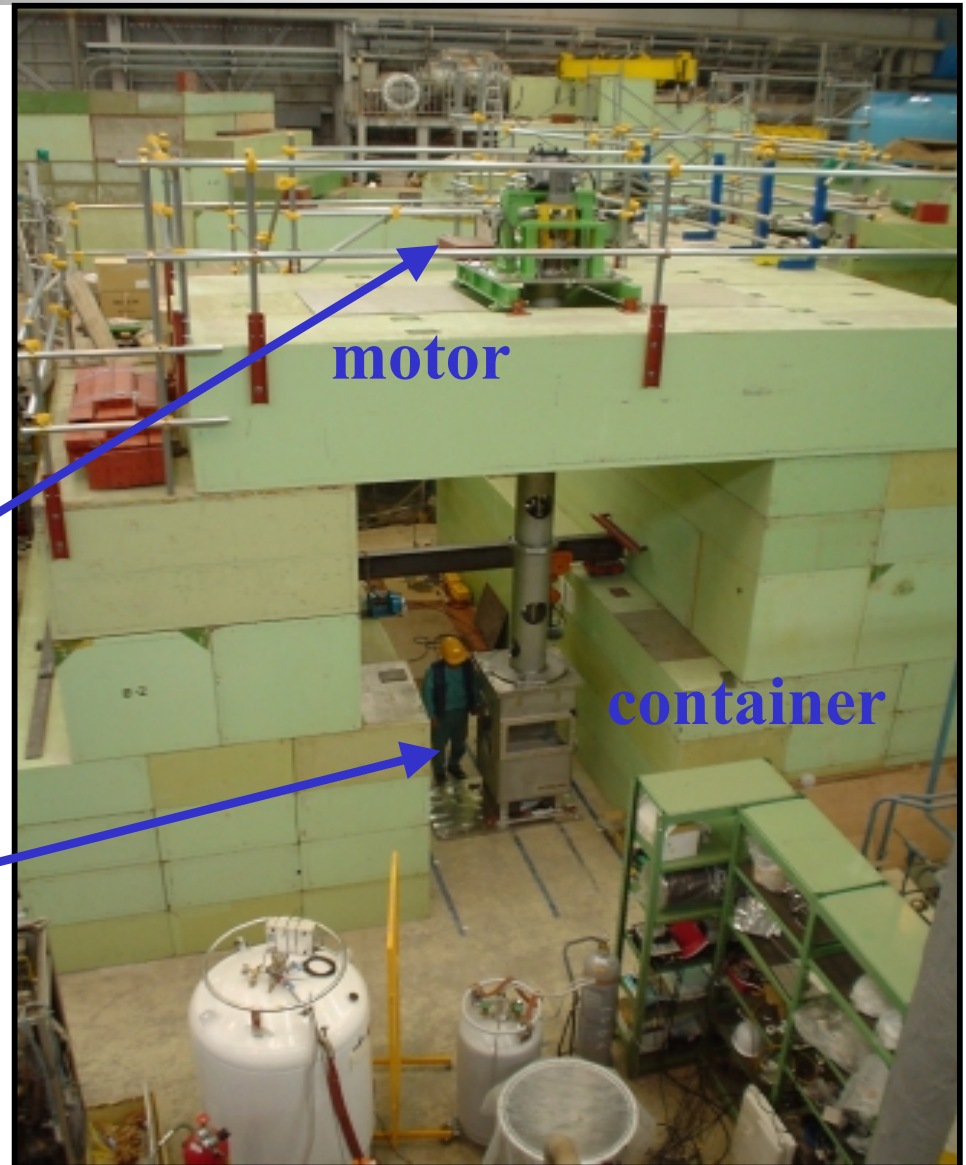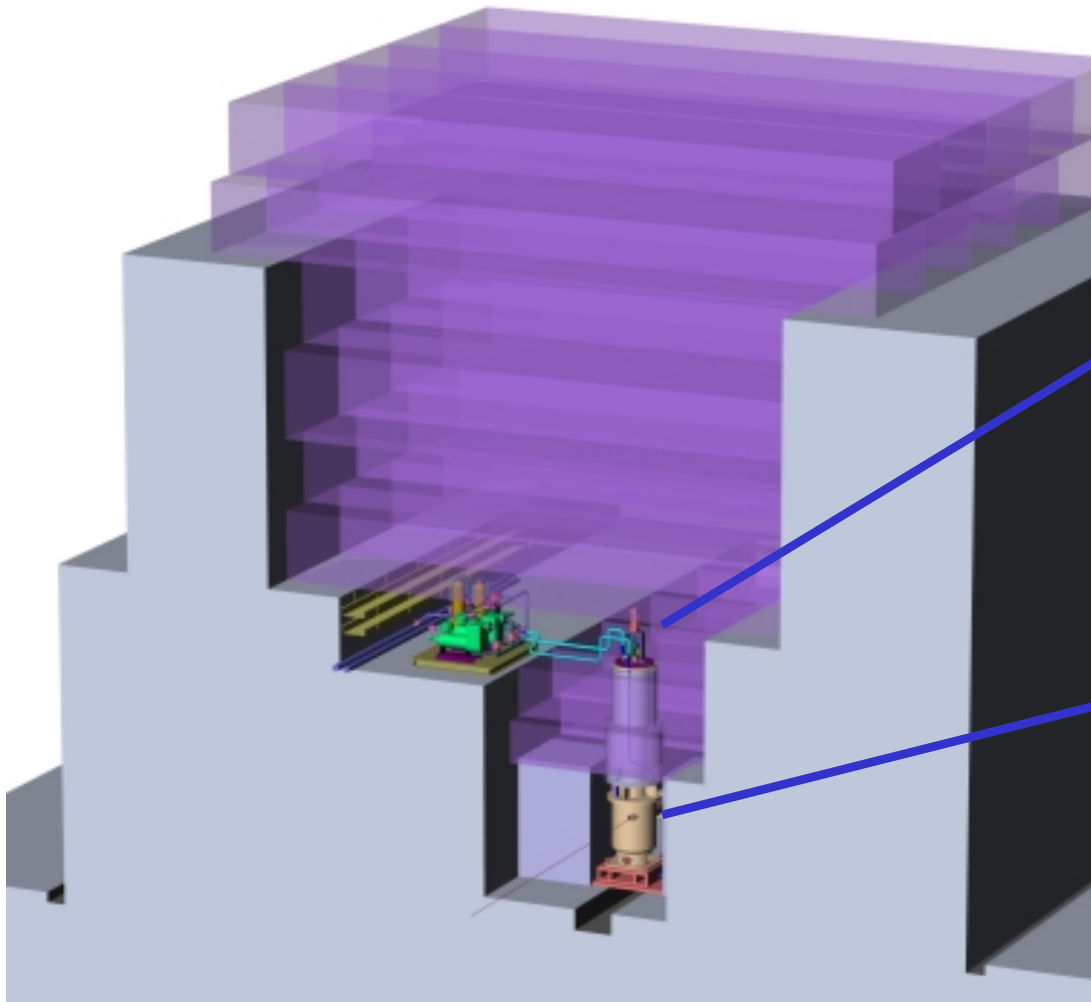

East counter hall at KEK




# Beam window for T1

**Double wall (SS and Al)**

- cooled by He flow
- gap: ~1cm
- remote maintenance


**Primary beam line:  $\sim 10^{-3}$  Torr**

**T1 upstream windows  
diameter: 10cm**

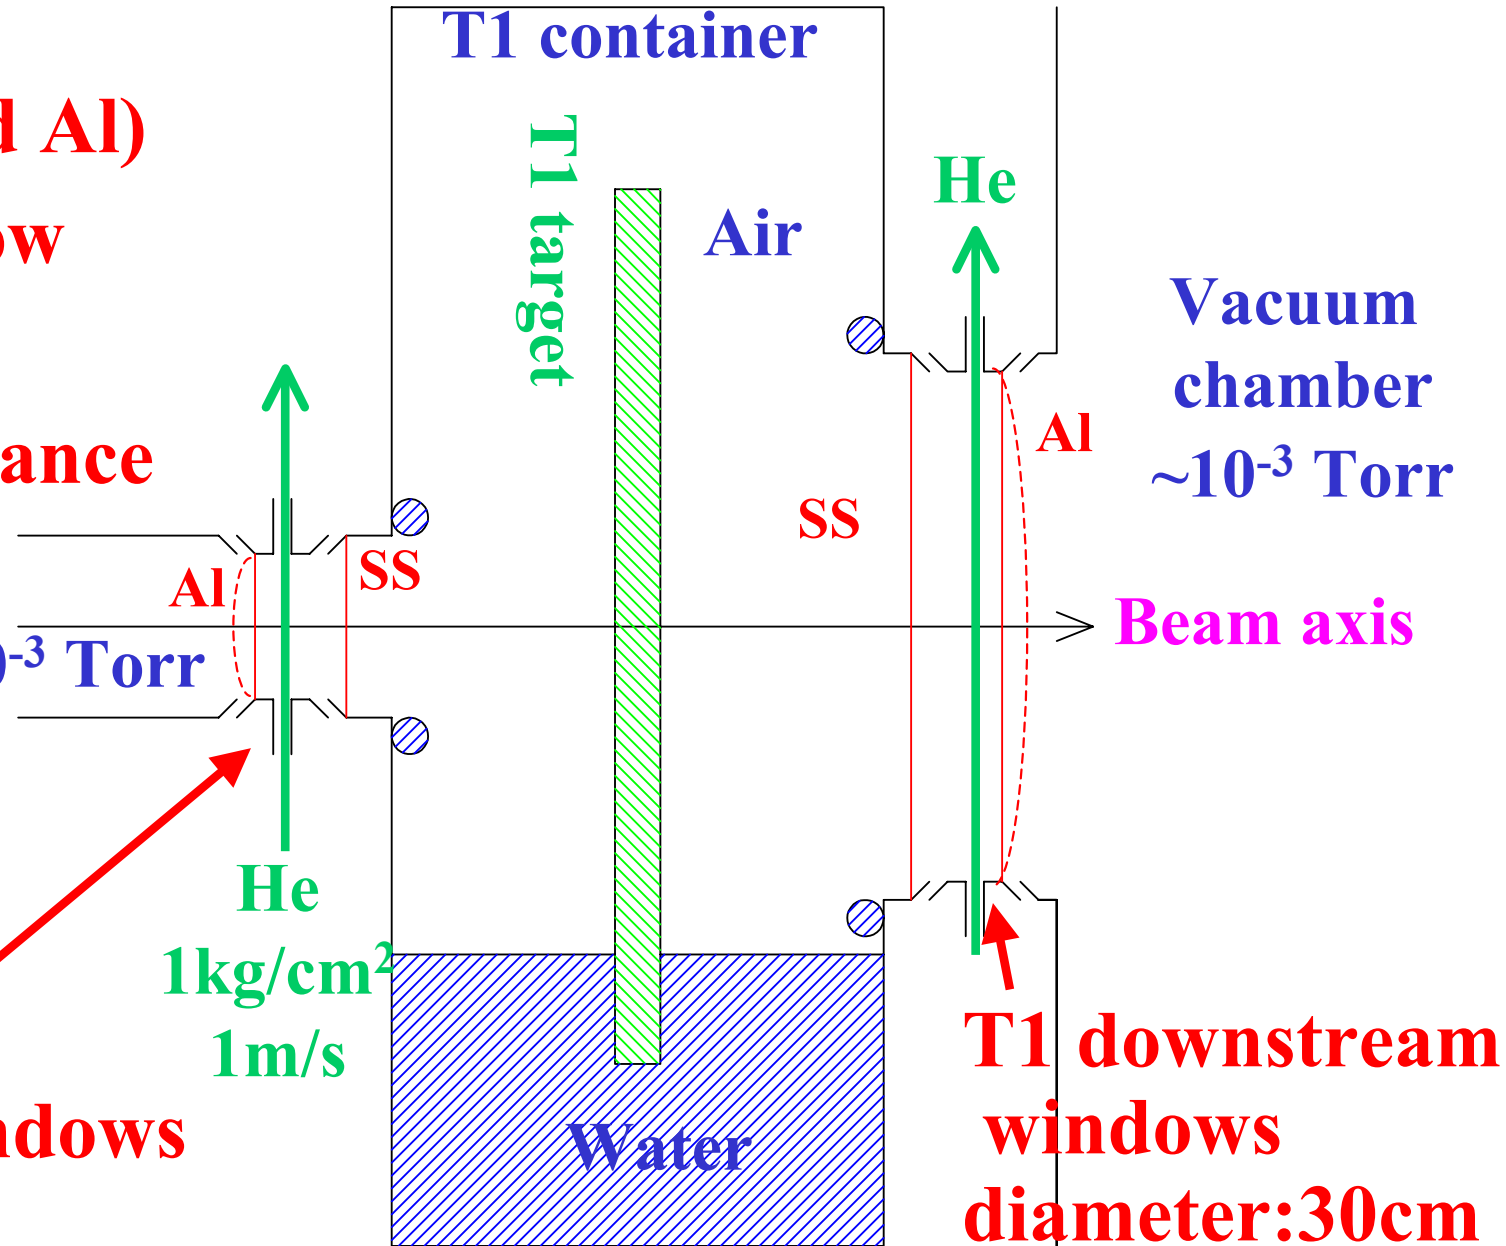

# T1 downstream window

- Diameter: ~30cm
- Vacuum side: Aluminum
- Air(T1) side: SS
- 0.1mm-t at center
- 5mm-t at edge (water cooled)

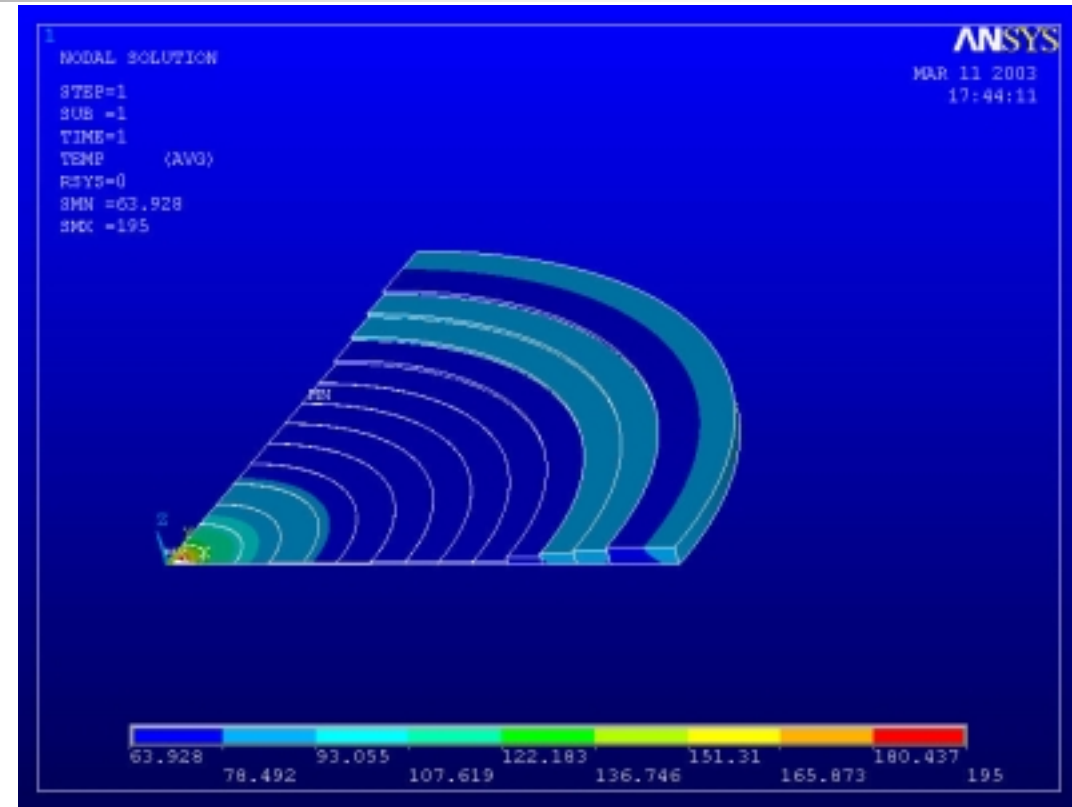


• **Temperature rise of SS window at center**

**+170°C (forced convection by He flow(~1m/s) : 100W/m<sup>2</sup>K)**


**+810°C (natural convection : 10W/m<sup>2</sup>K)**

# Shield around T1

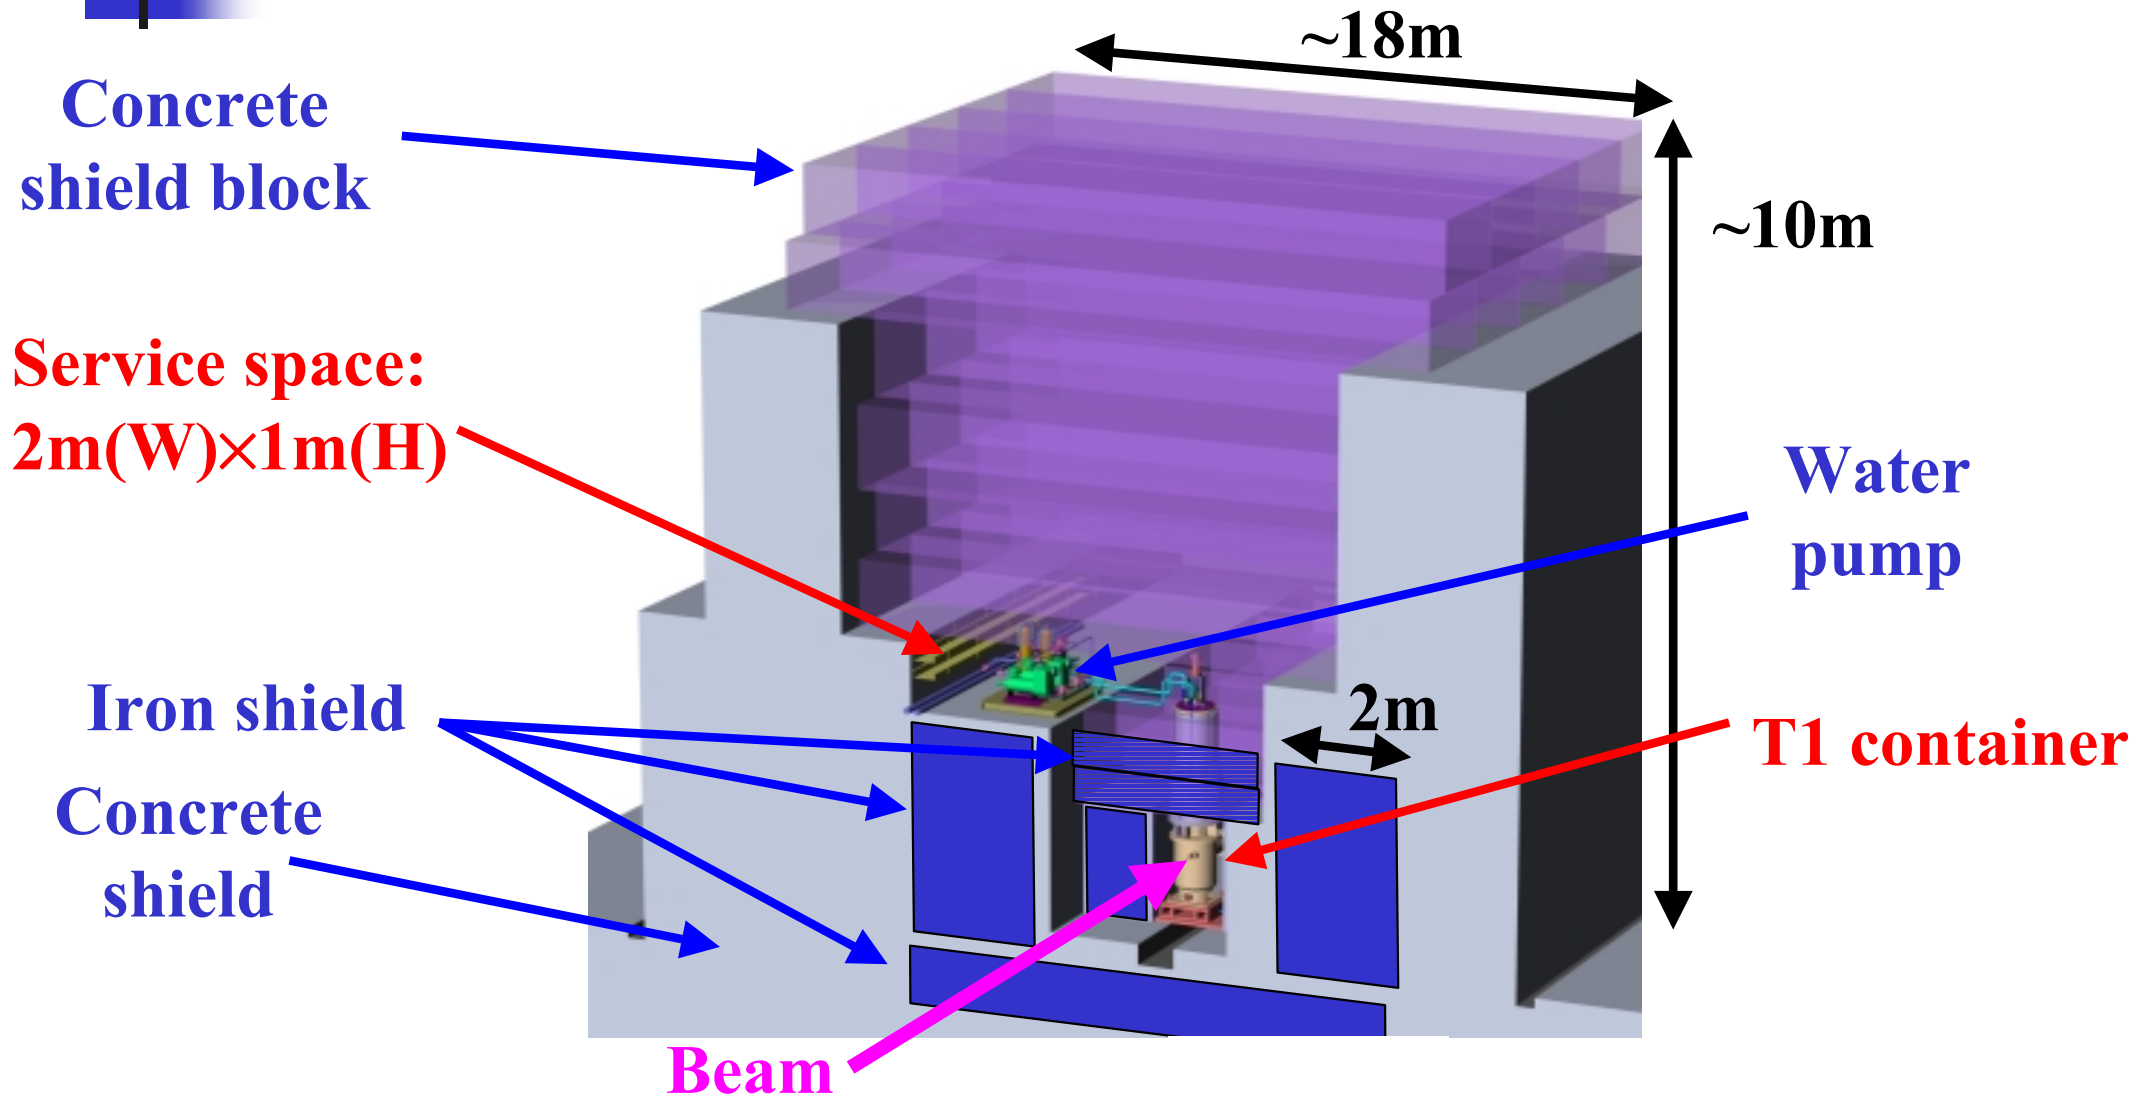


The whole system will be tested by the T1 mockup.

# Target Area

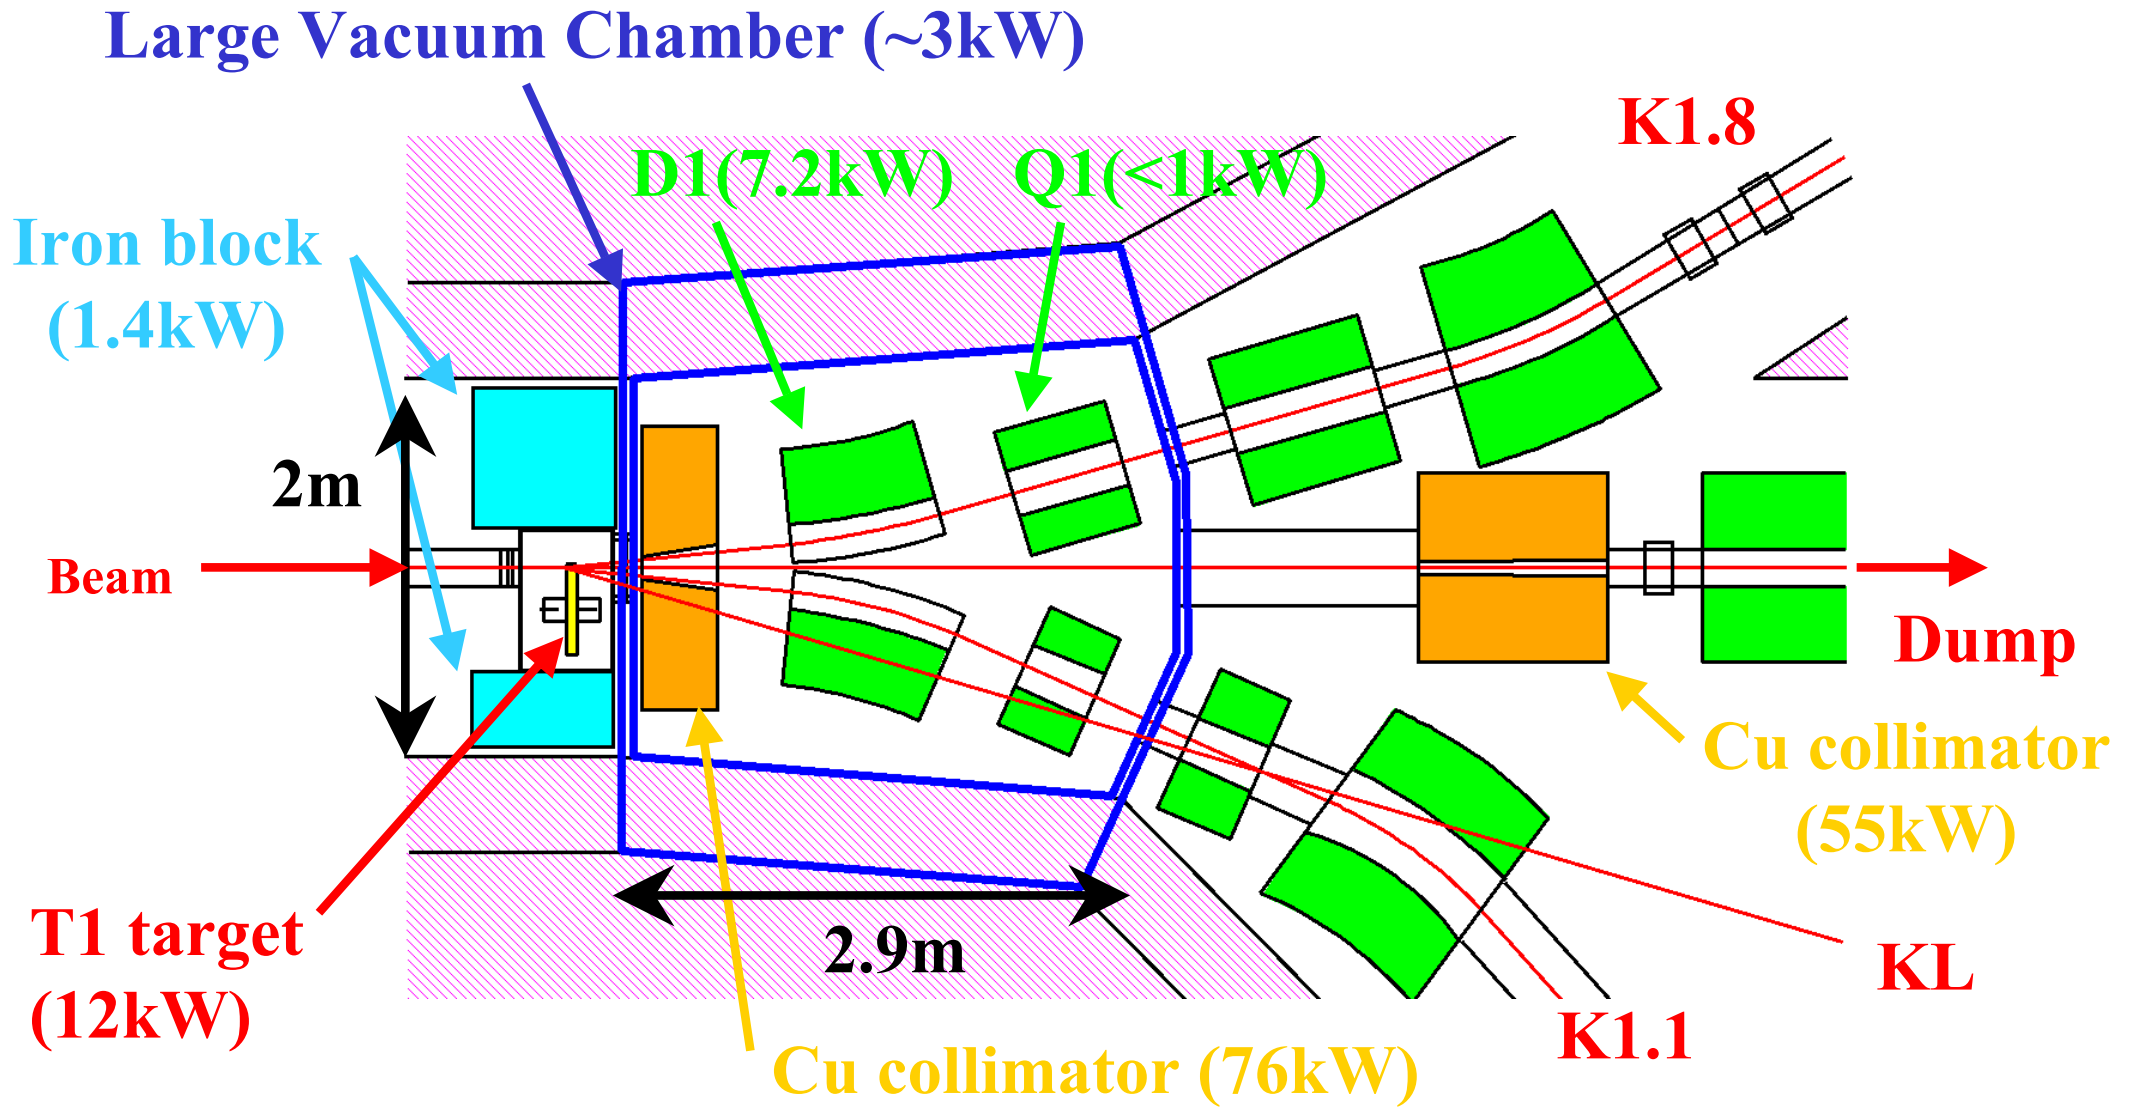

# Residual dose around T1

Dose by MARS  
 One day cooling  
 after 30-days operation  
 Half year cooling  
 after 1-year operation

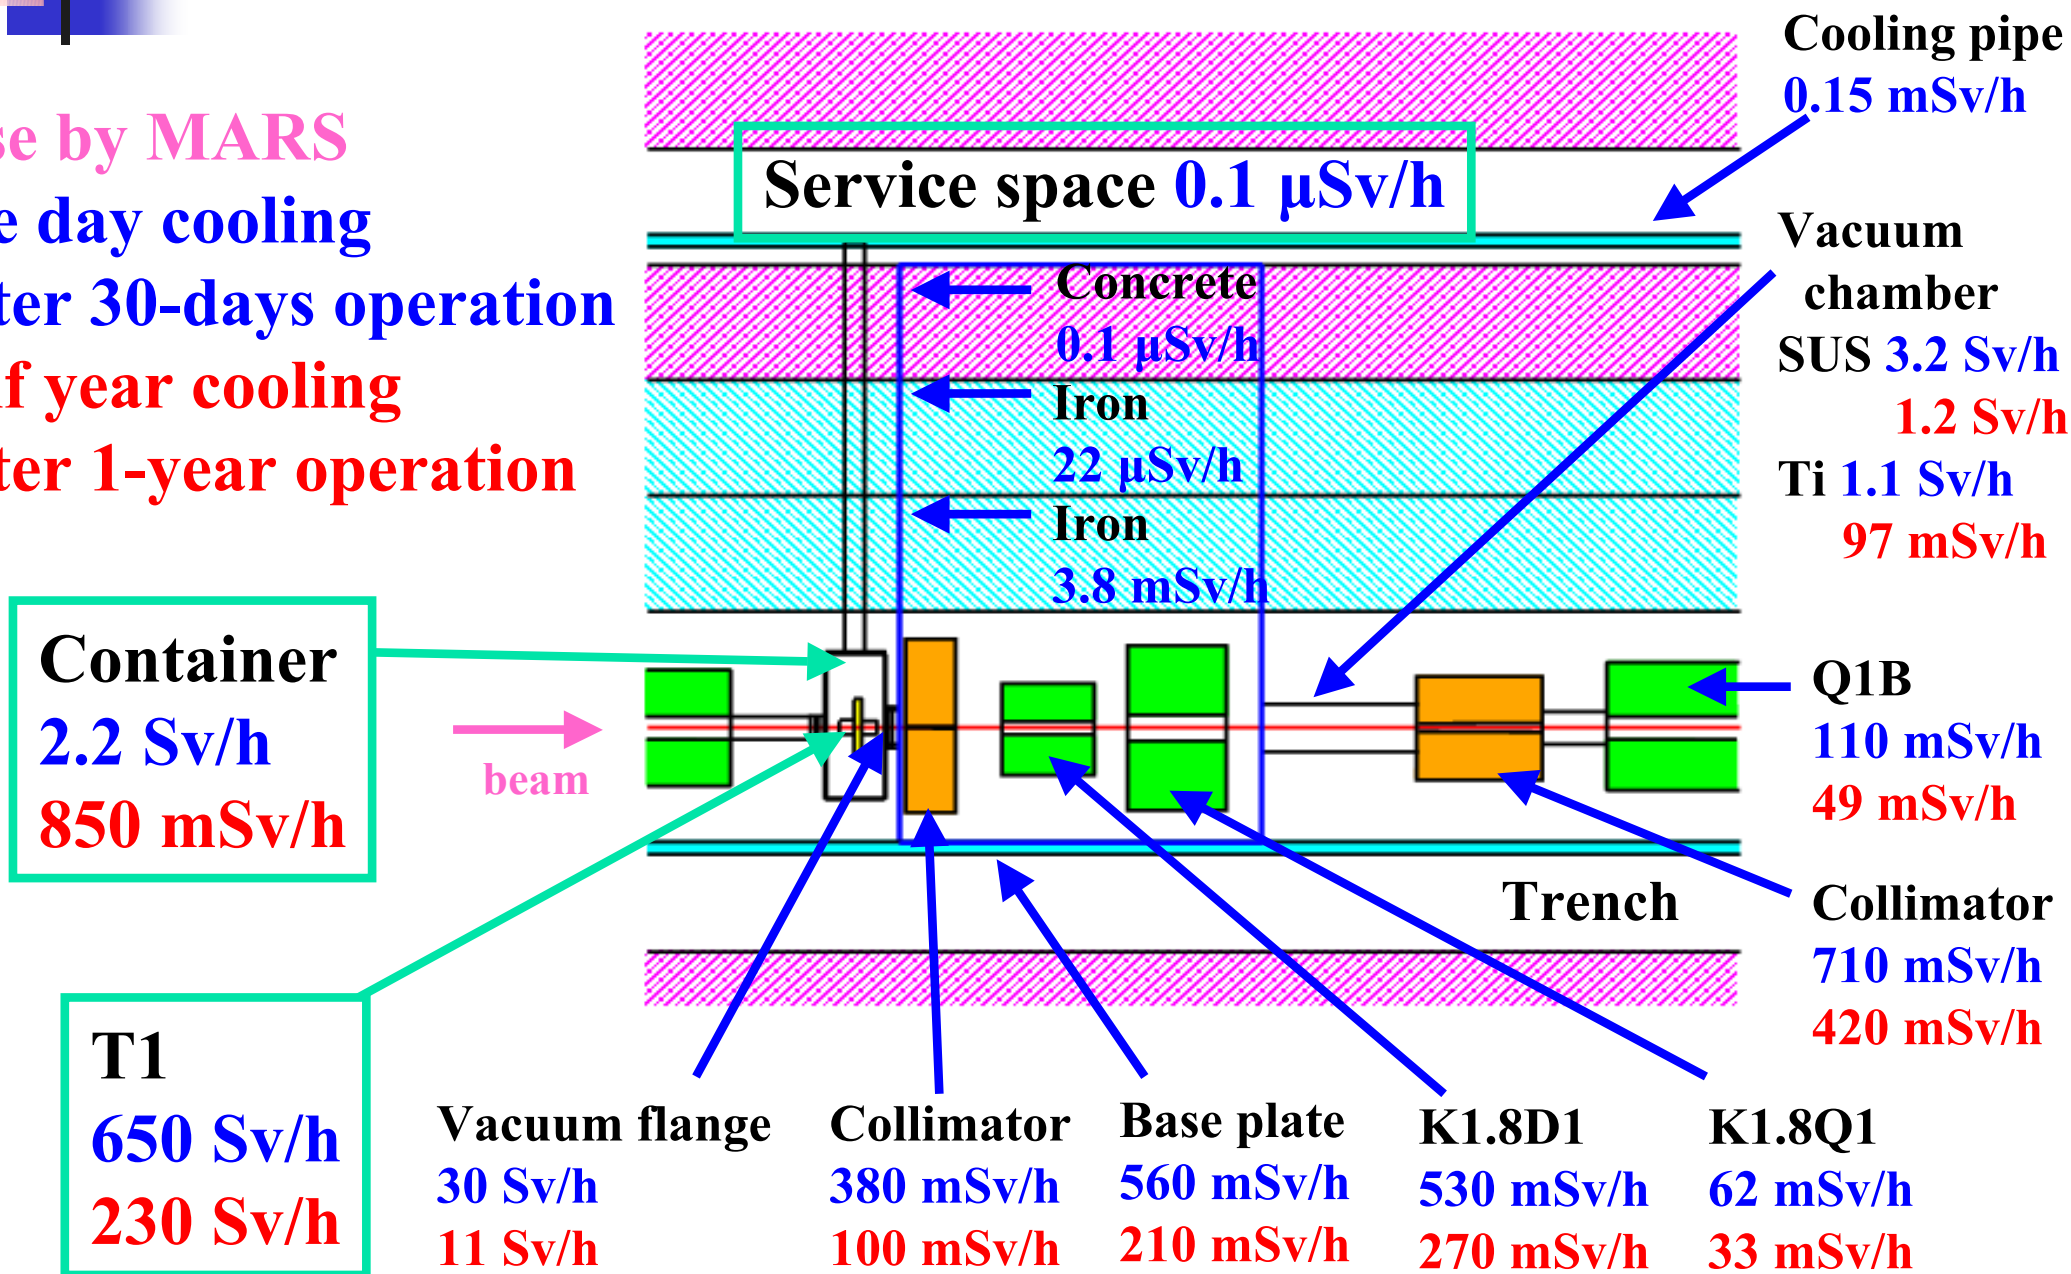


# Remote maintenance for T1

## Maintenance work

should be done at service space

1. Disconnect cables and cooling tubes.
2. Detach vacuum flanges.
3. Replace shields with cask.
4. Detach shaft, disks and upper plate, and move them to stock space.
5. Install new parts with cask.
6. Replace cask with shields.
7. Connect cables and tubes.

requires remote maintenance tools

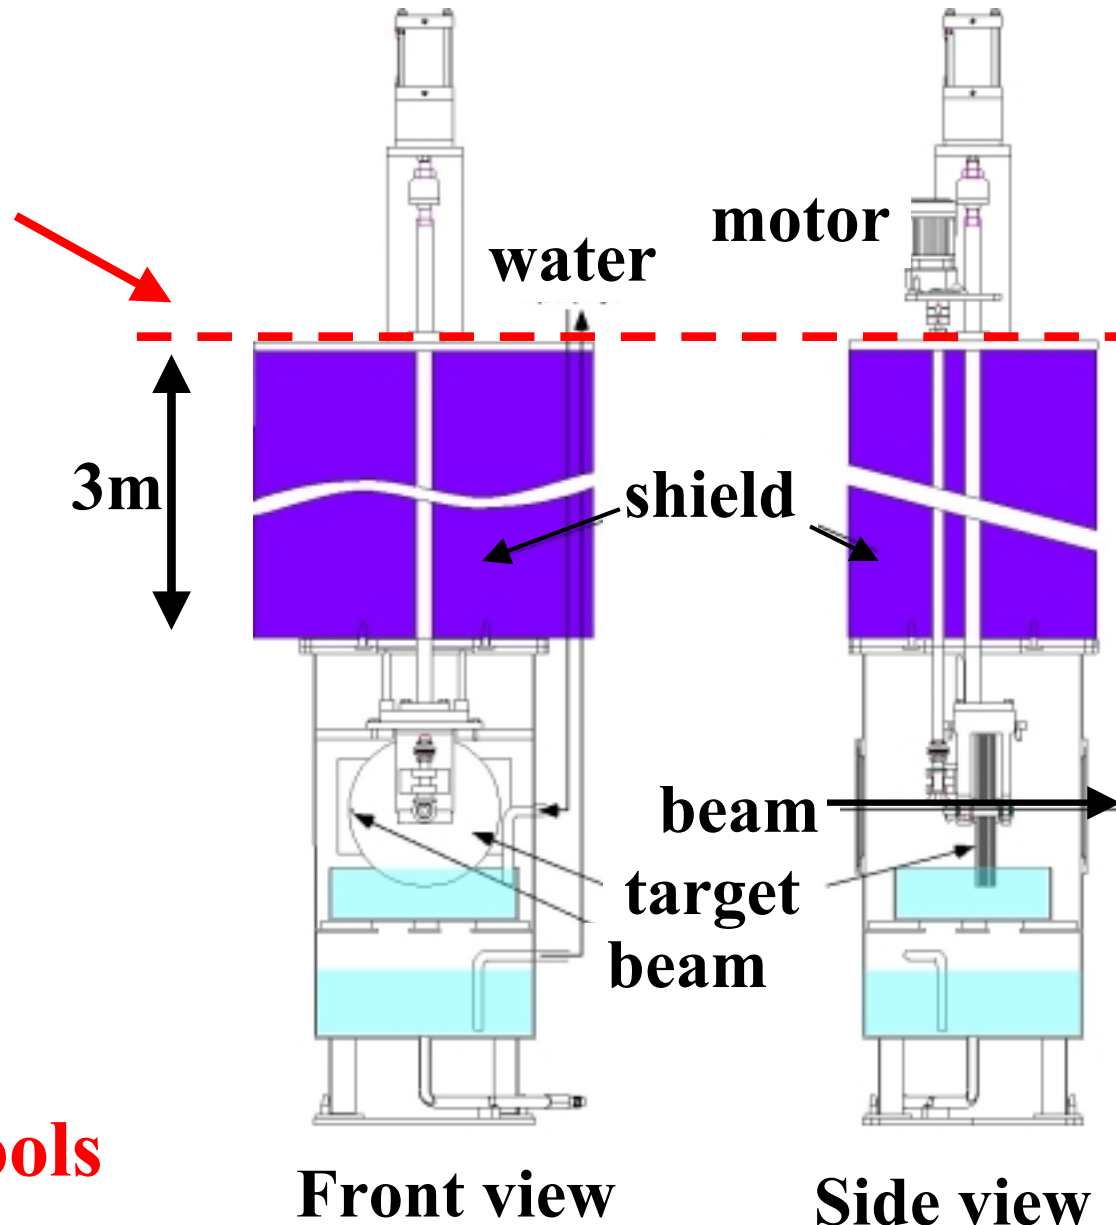

# Remote vacuum sealing

## Design specification

- Inner Diameter:  $\geq 30\text{cm}$
- Metal sealing
- Small leak:  $\sim 1 \times 10^{-10} \text{ Pa} \cdot \text{m}^3/\text{s}$
- Remote operation
  - Operation time: 1~5 min.
  - Small force required

## Candidate

- Mechanical holding (V-block)
- Pillow seal
- **Radial seal (under development)**




**Prototype of “Radial seal”**  
developed by Y.Yamanoi(KEK) ,  
M.Tsuchiya(IHI Ltd) and  
Usui Kokusai Sangyou Kaisya Ltd.

# Remote lifting Tools

## Specification

- Up to 40t
- Short height
- Remote connection
- Video camera viewing
- Two or four points lifting
- Interlock for one-side lifting

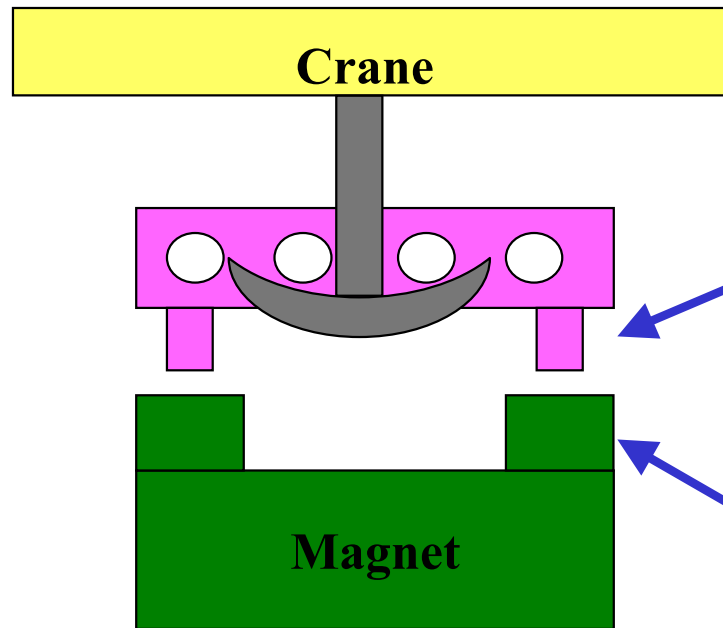


Under design



Lifting tools from  
CERN and PSI



# Neutrino beam line

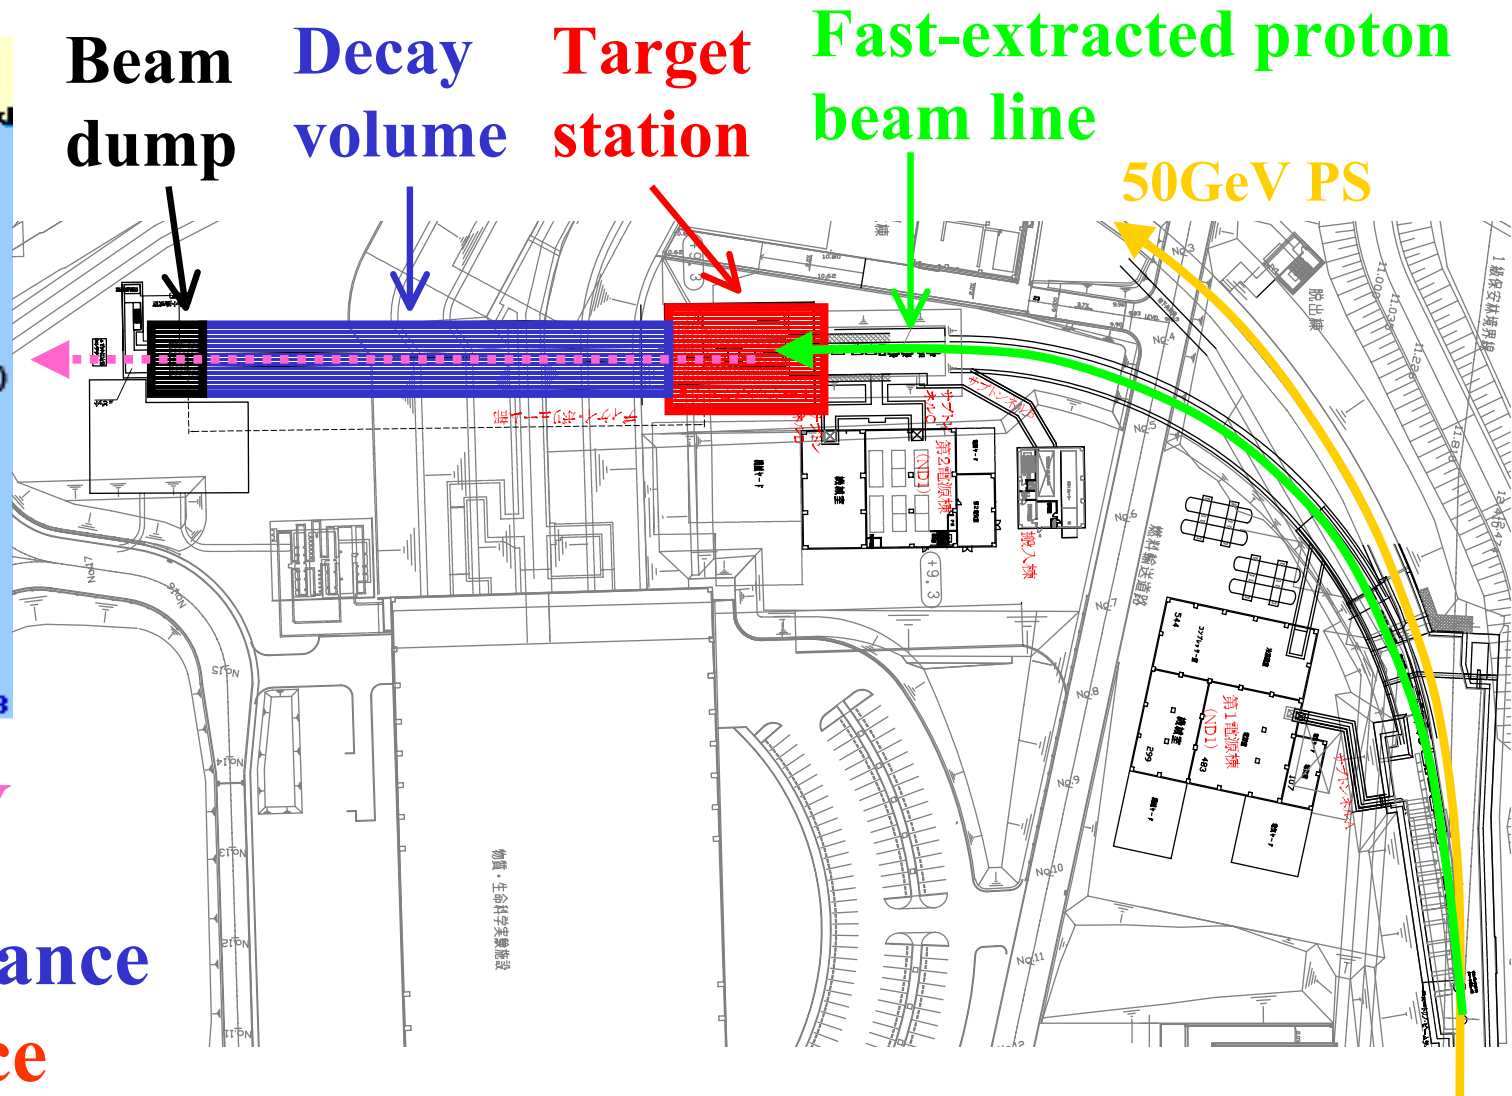

$\nu_{\mu}$  beam of  $\sim 1\text{GeV}$

●  $\nu_{\mu} \rightarrow \nu_{\tau}$  disappearance


●  $\nu_{\mu} \rightarrow \nu_{e}$  appearance

# Neutrino target


## Graphite rod

- diameter: 30mm, Length: 900mm (80% interaction)
- beam size:  $\sigma_r \sim 6\text{mm}$
- fixed inside 1st horn
- 20kw heat load: cooled by water

⇒ Hayato's talk tomorrow

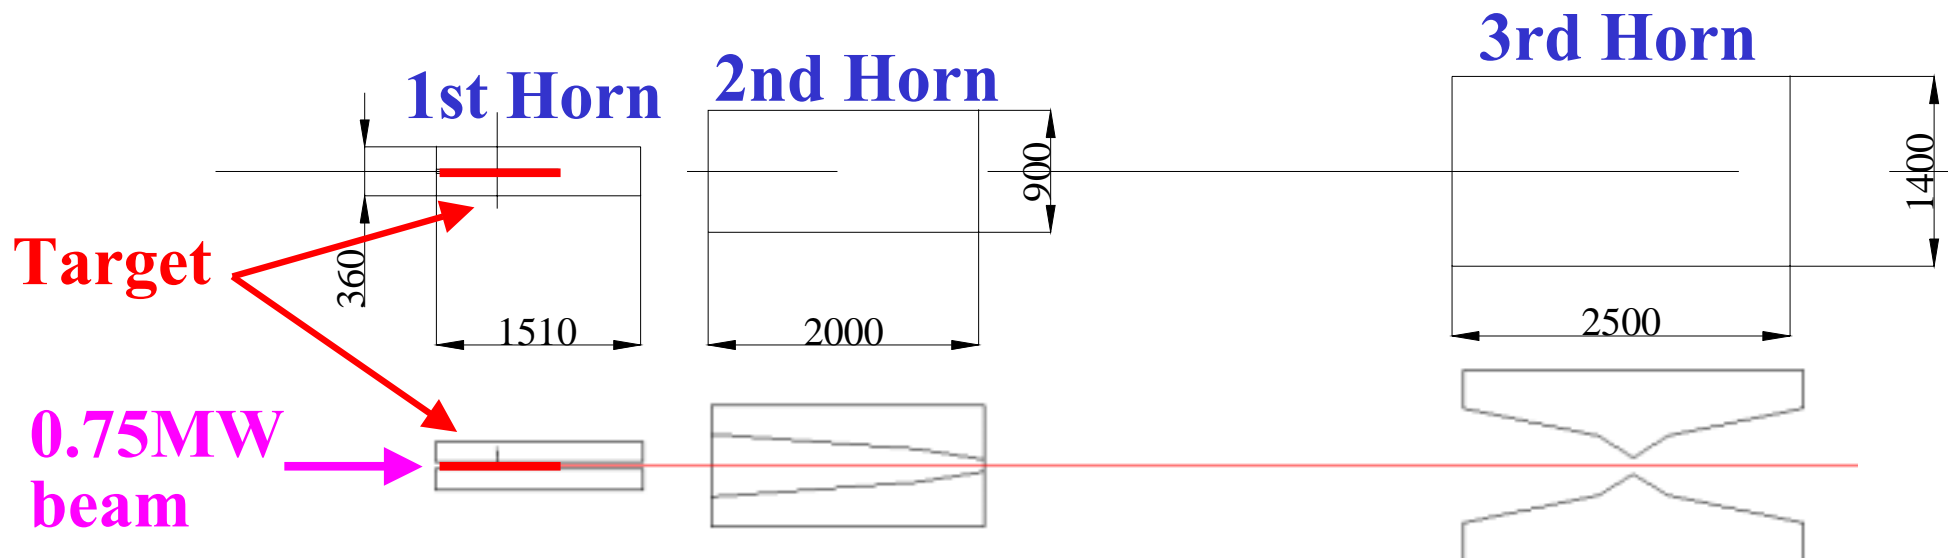

# Neutrino target station

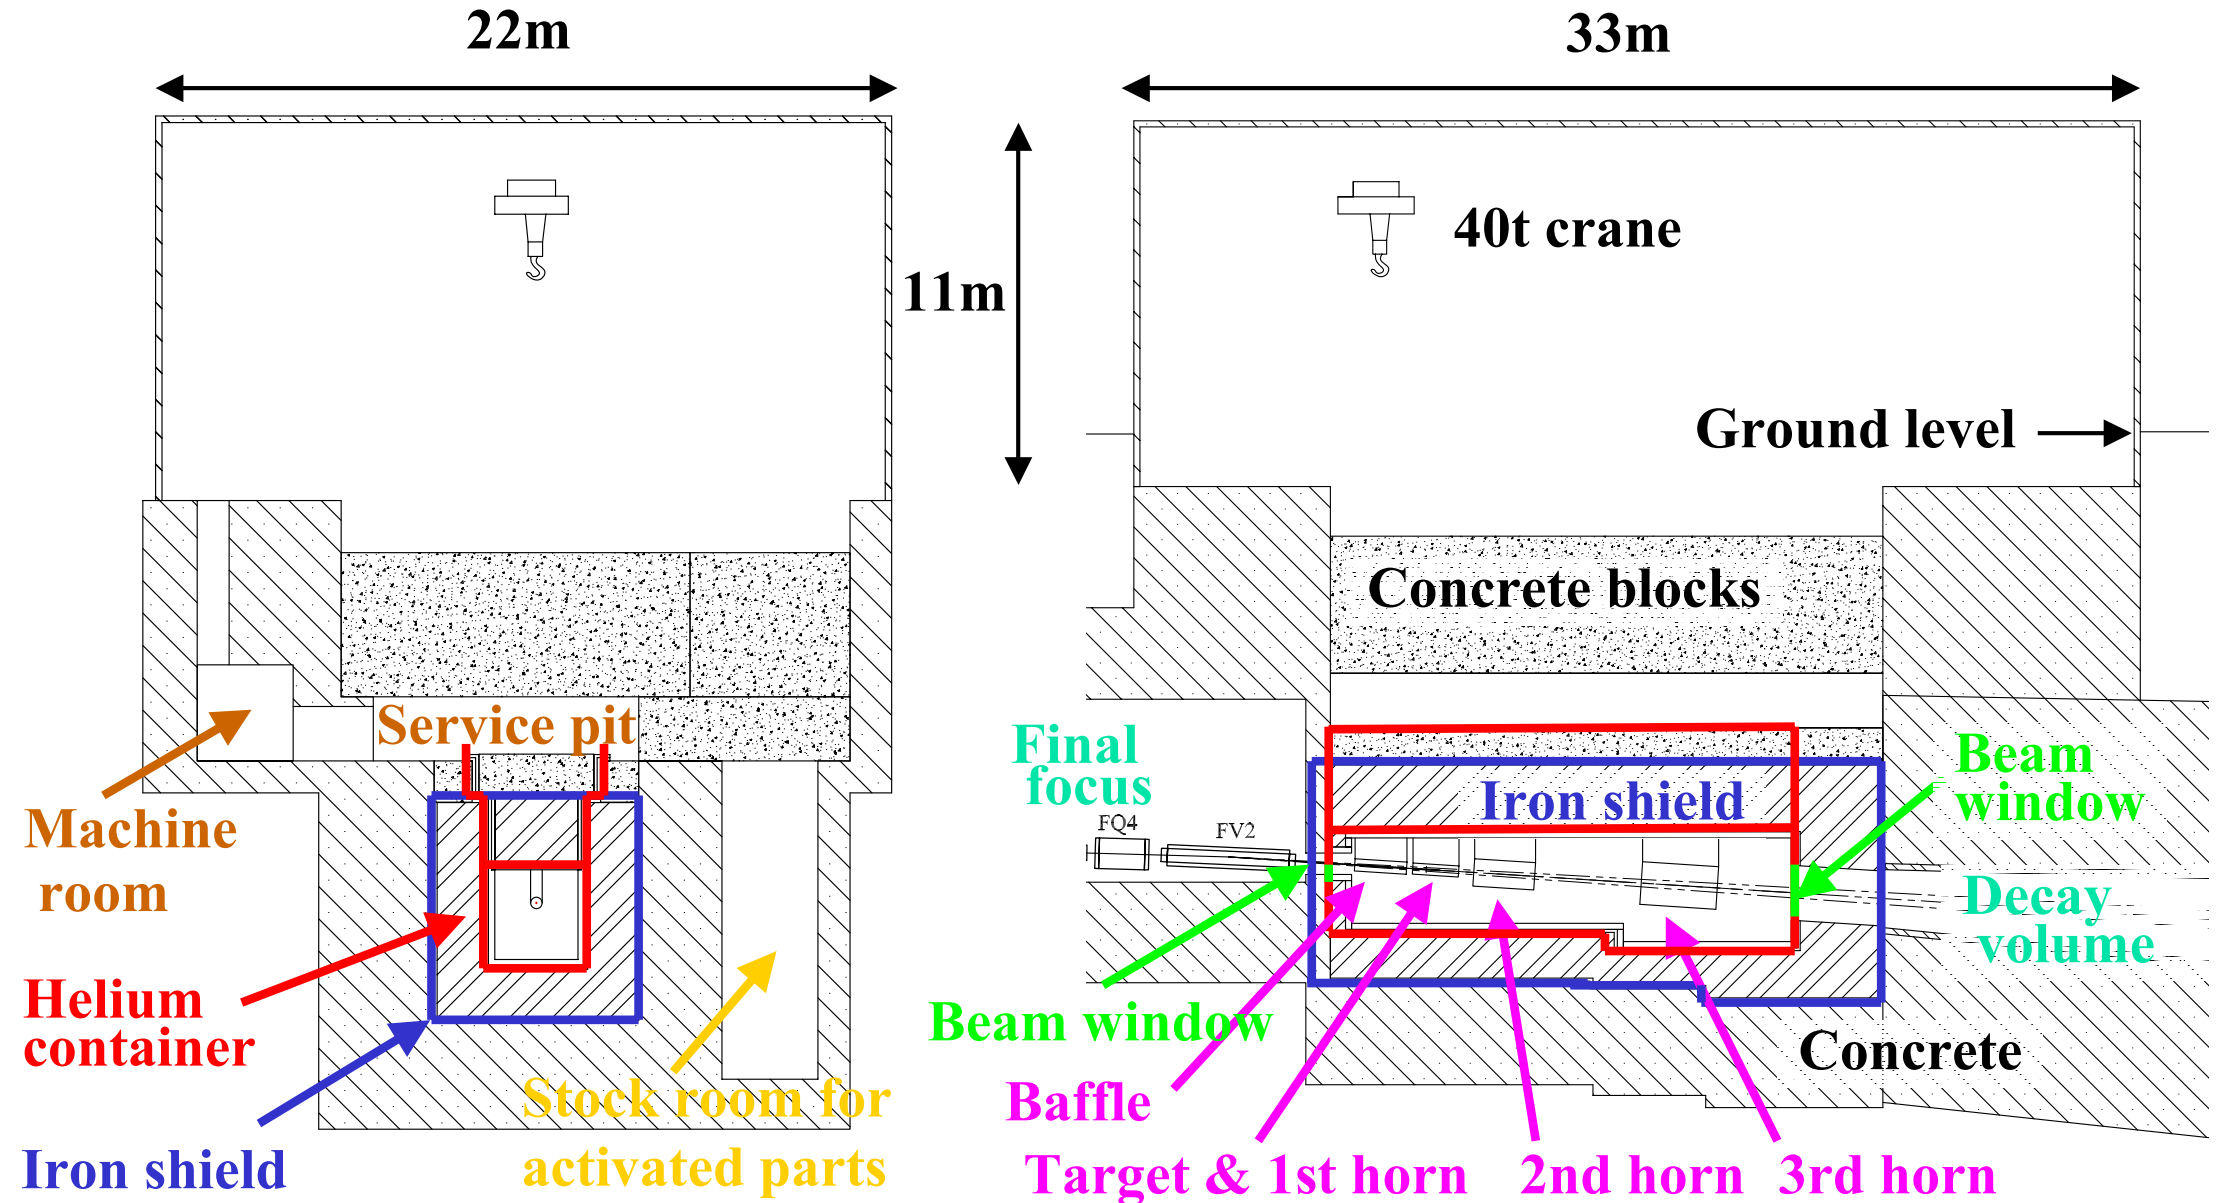


# Radiation shield and dose

Floor:  $<12.5 \mu\text{Sv/h}$


Radiation dose  
in 0.75MW operation  
(by MARS)

Outer surface of concrete  
:  $<5\text{mSv/h}$

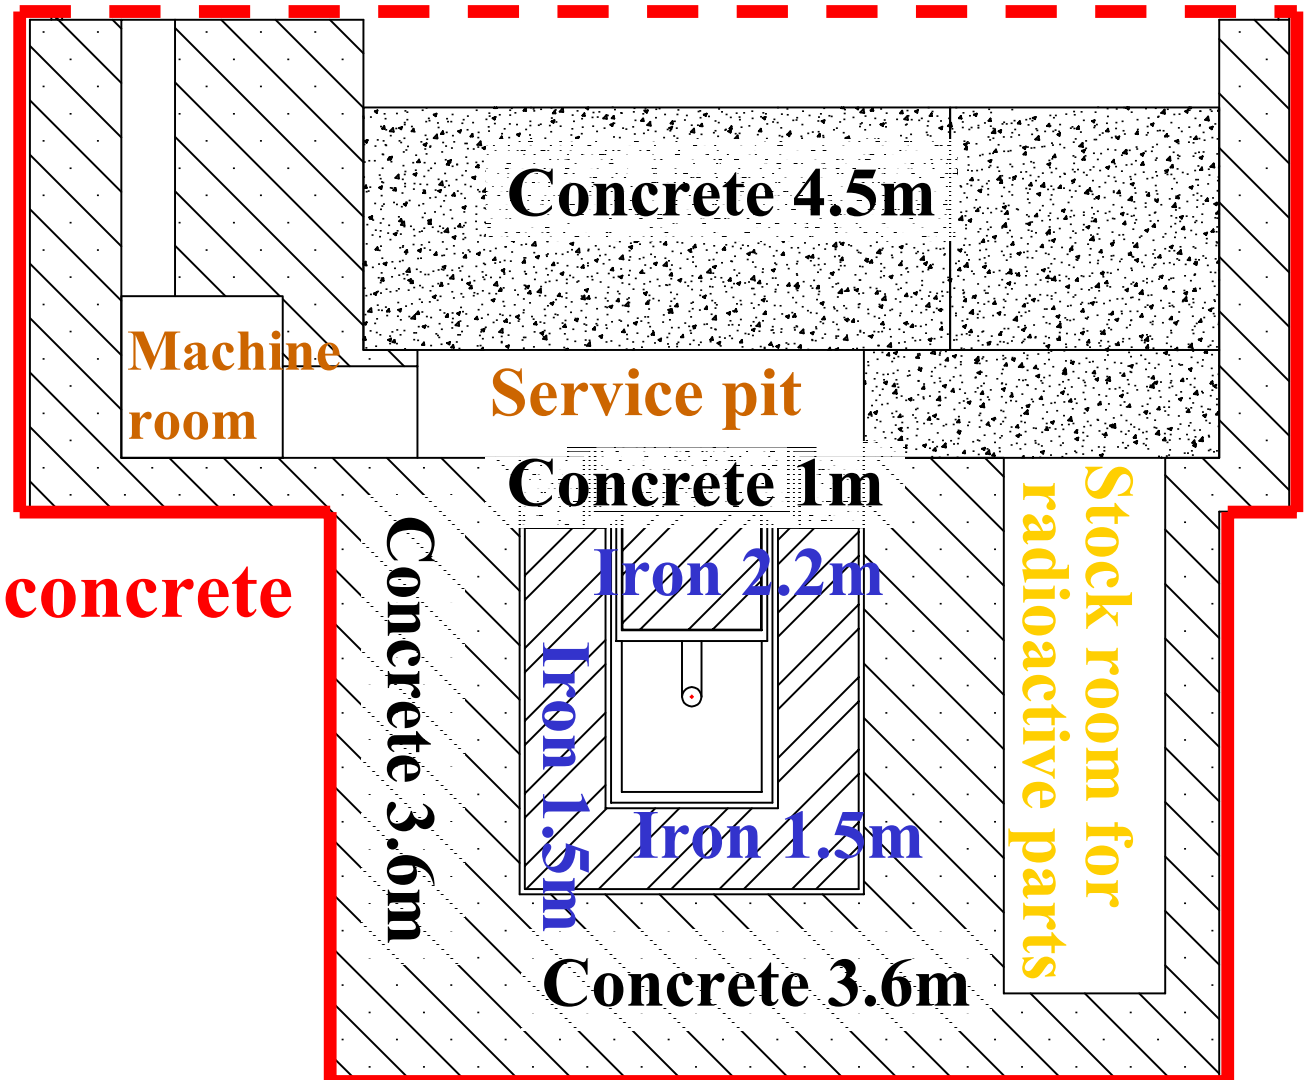

# Helium container

- Reduce radioactivity in gas and corrosion by NO<sub>x</sub>
- 3m(W)×6m(H)×15m(L), 20cm thick Aluminum
- Filled by 1 kg/cm<sup>2</sup> Helium gas (130m<sup>3</sup>)
- Heat load ~170 kW: water cooled
- Under conceptual design

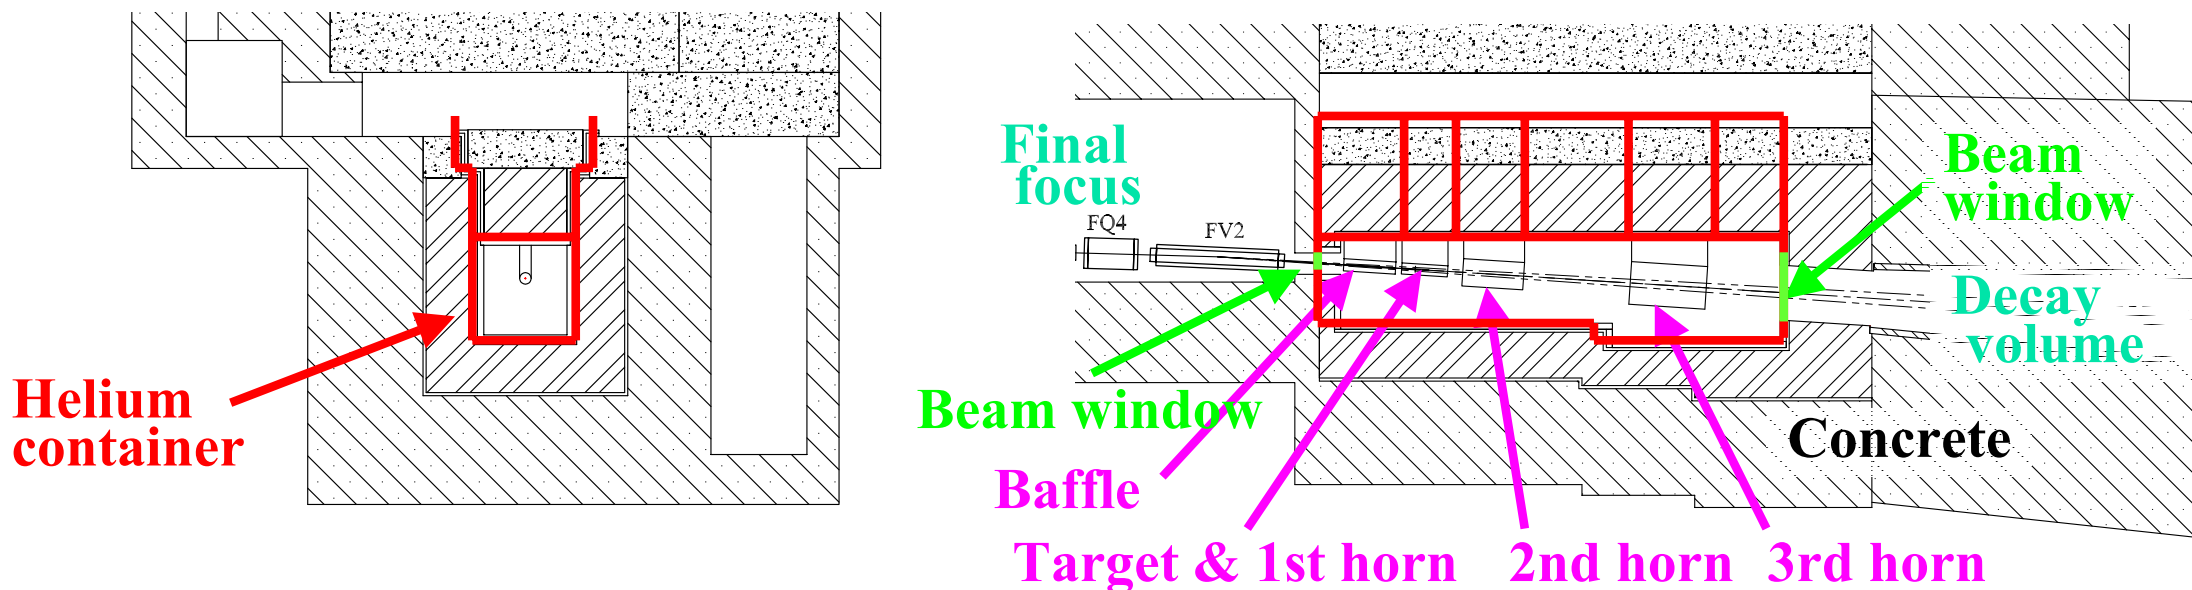

# Residual dose


Residual does:

one (seven) day cooling  
after one year operation  
(by MARS)

Floor of service pit  
 $\sim 0.007(0.004) \mu\text{Sv/h}$



Upper iron shield  
Outer :  $22(16) \mu\text{Sv/h}$   
Inner :  $0.56(0.42) \text{Sv/h}$

Helium container (Aluminum)  
 $\sim 0.65(0.17) \text{Sv/h}$

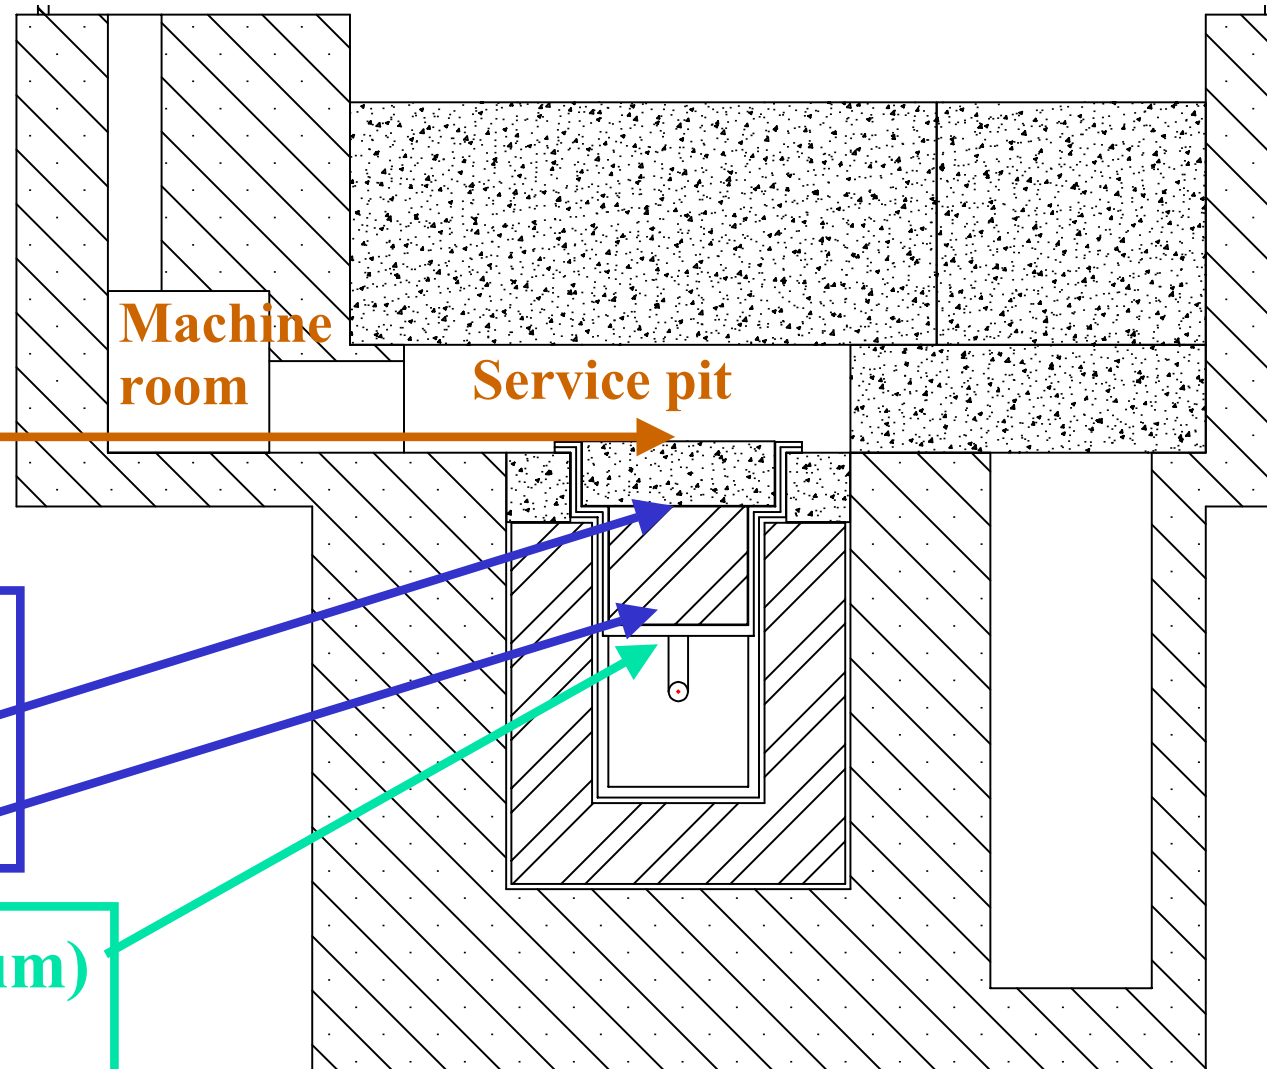

# Stock room for activated parts

- Stock broken and activated targets/horns etc (5~20 years?)
- Use cask and move under ground level

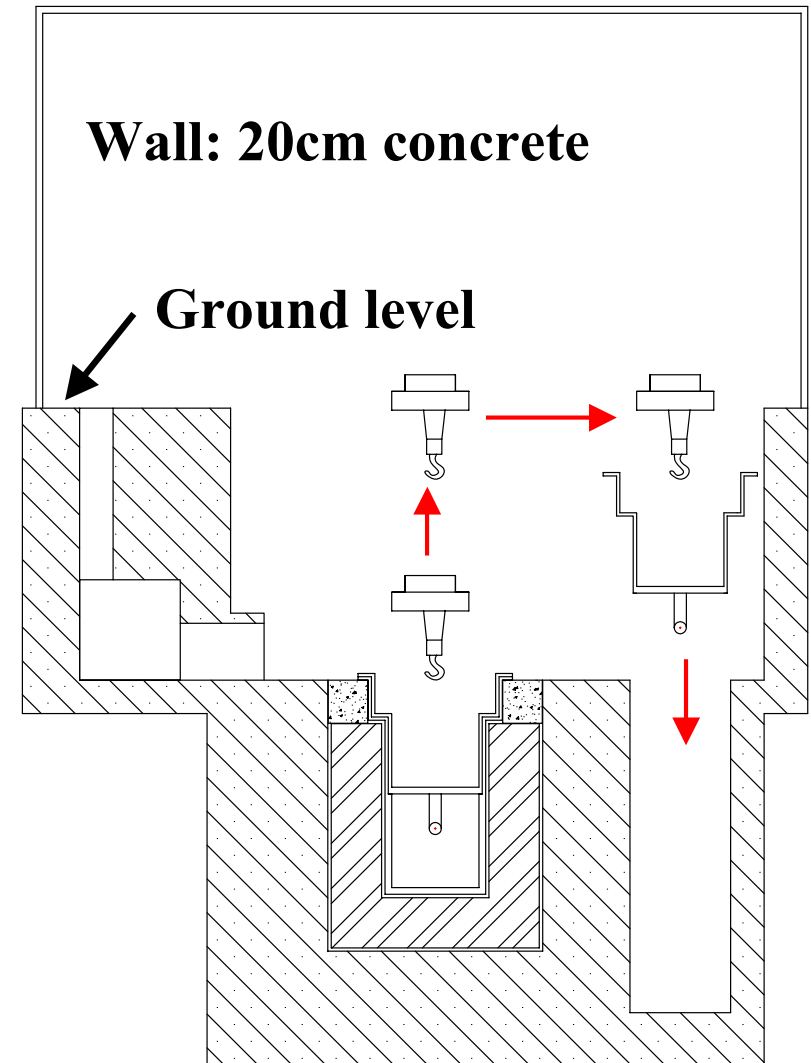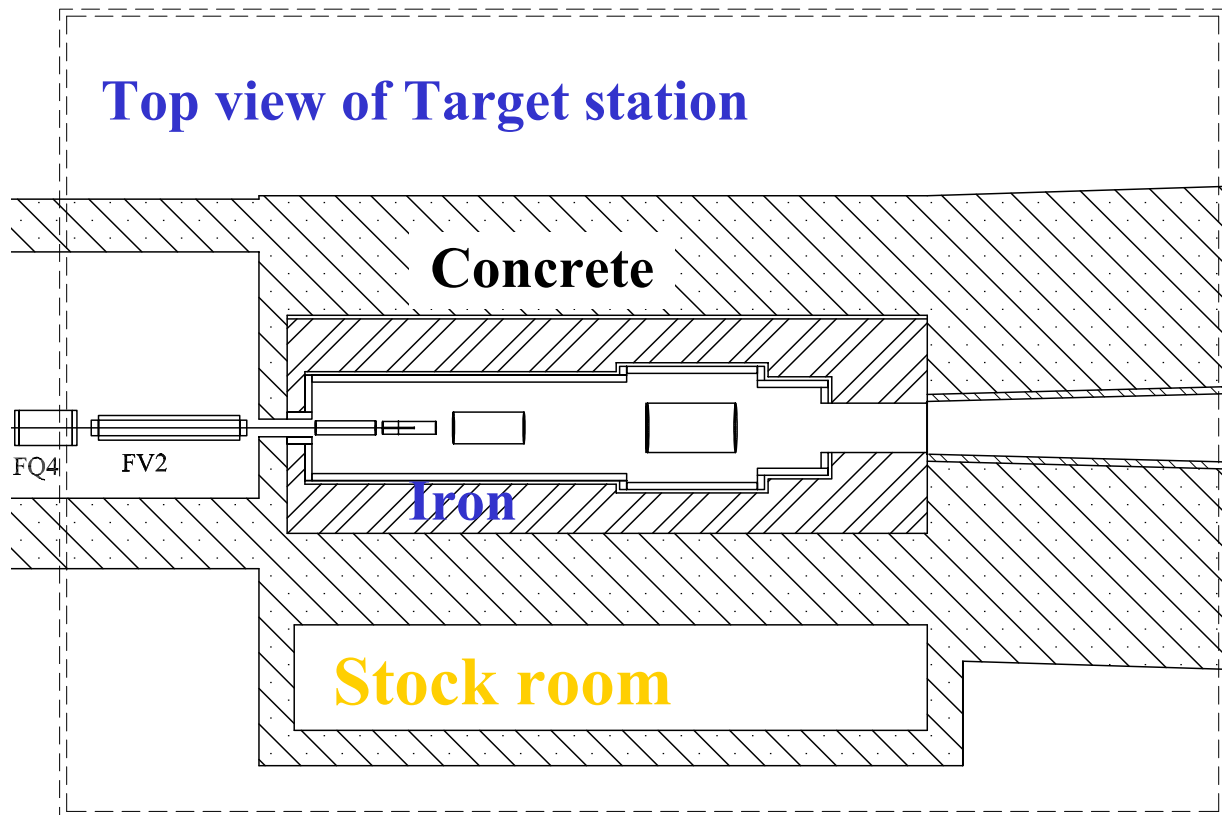

# Control of air

Service pit(230m<sup>3</sup>)

Machine room(140m<sup>3</sup>)

Keep out in operation time

- Operation time:circulation
- Maintenance:ventilation

Helium container:

Keep out forever

- Circulation of Helium


Stock room for radioactive parts

Keep out forever

- Operation time:circulation
- Maintenance:ventilation

Building (8300m<sup>3</sup>):

- Ventilation through stack

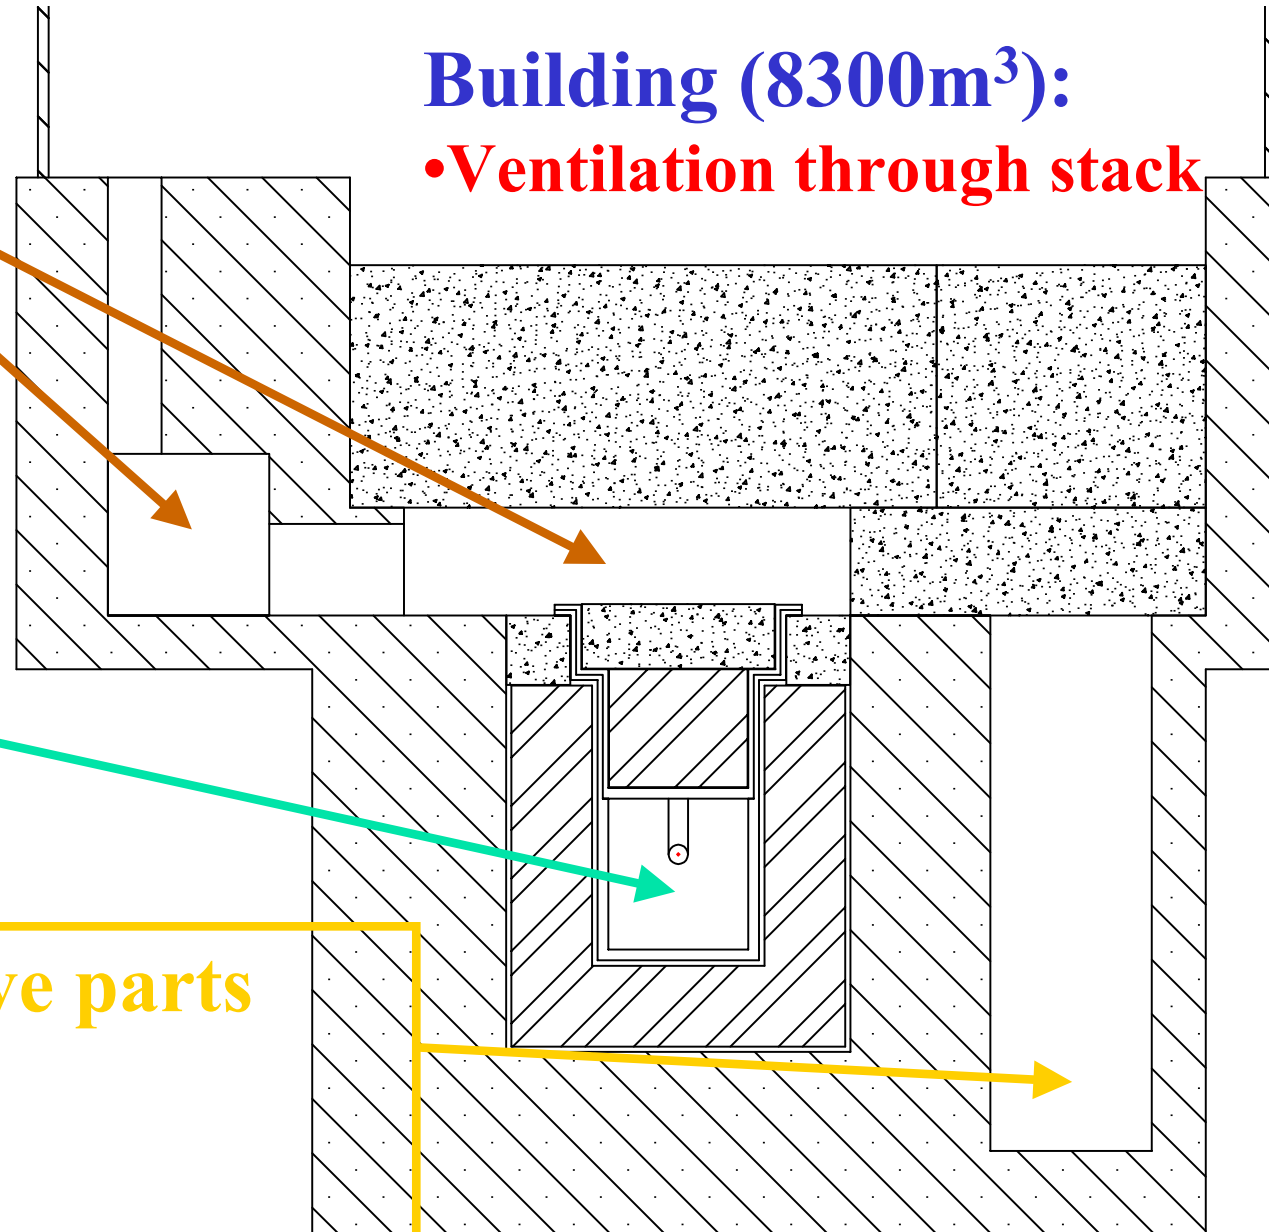





# Cooling and radioactivity

---

After 3 weeks of 0.75MW operation,

•Target (heat load:20kW) :

**0.001m<sup>3</sup> & 300kBq/cm<sup>3</sup>**

**⇒ thinned into 20m<sup>3</sup> of 15 Bq/cm<sup>3</sup> and thrown away**

•Horns (heat load:~30kW) :

**0.6m<sup>3</sup> & 5kBq/cm<sup>3</sup>**

**⇒ 200m<sup>3</sup> of 15 Bq/cm<sup>3</sup>**

•Iron shields & Helium container (heat load~210kW) :

**~0.1m<sup>3</sup>, ~30kBq/cm<sup>3</sup>**

**⇒ ~200m<sup>3</sup> of 15 Bq/cm<sup>3</sup>**



# Summary

---

## **Target system for 0.75MW-50GeV beam at J-PARC**

- **under design and R&D stage  
and will be completed by 2007~2008**
- **Ni disks for hadron beam line**
- **Carbon rod for neutrino beam line**
- **Key points on target system**
  - **Radiation level and residual dose**
  - **Remote maintenance**
  - **Cooling**
  - **Cost, man power, schedule, etc.**